



"SAFETY EDGE" & POLYCARB STORM PANELS


28ga (0.018") STEEL & 0.100" POLYCARB

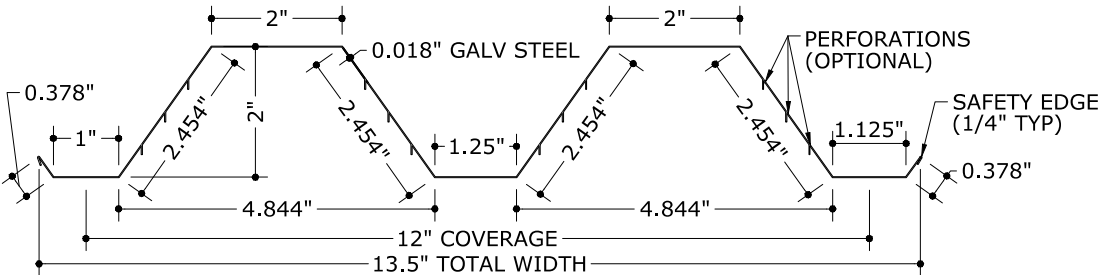


1a STEEL STORM PANEL PROFILE
4" = 1'-0" SECTION

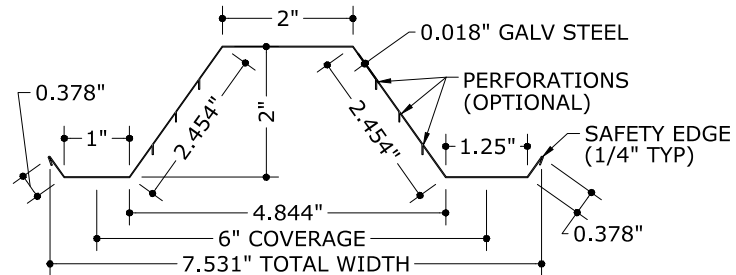


1b STEEL HALF-PANEL PROFILE
4" = 1'-0" SECTION

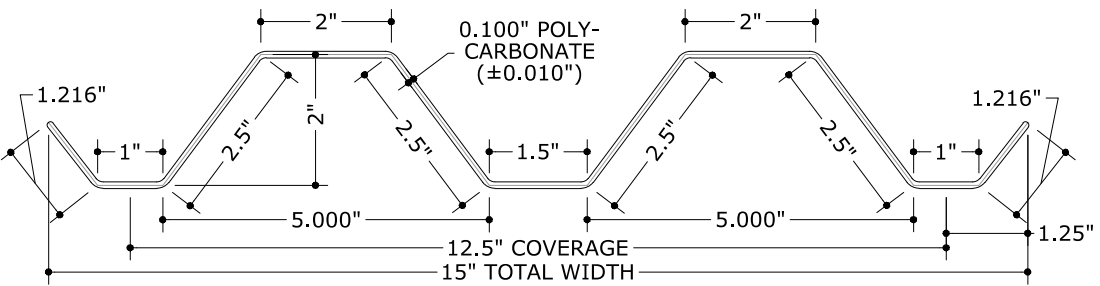

1c POLYCARB STORM PANEL PROFILE
4" = 1'-0" SECTION

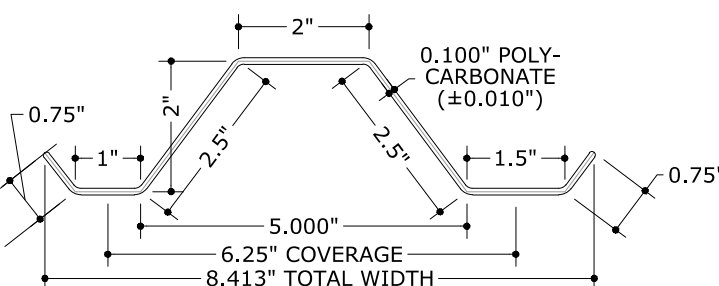


1d POLYCARB HALF-PANEL PROFILE
4" = 1'-0" SECTION

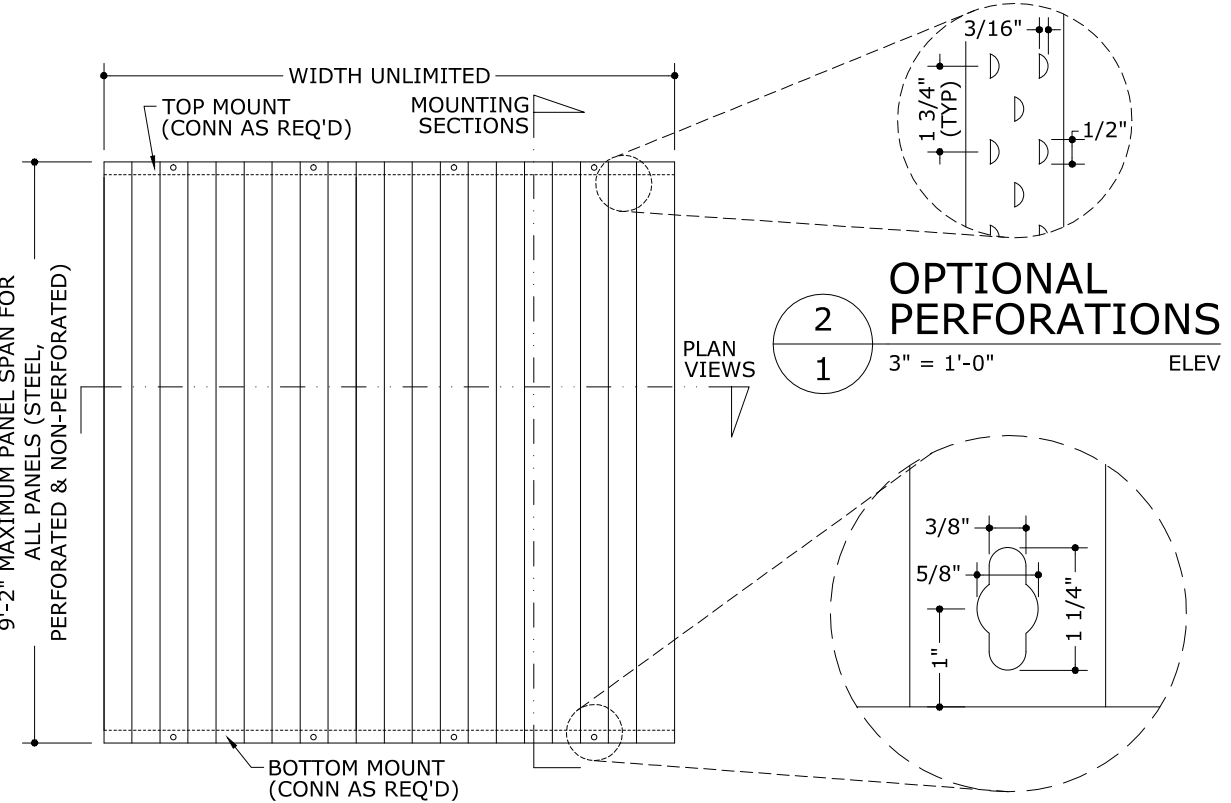


1 TYPICAL ELEVATION
1 N.T.S.


2 OPTIONAL PERFORATIONS
1 3" = 1'-0" ELEV

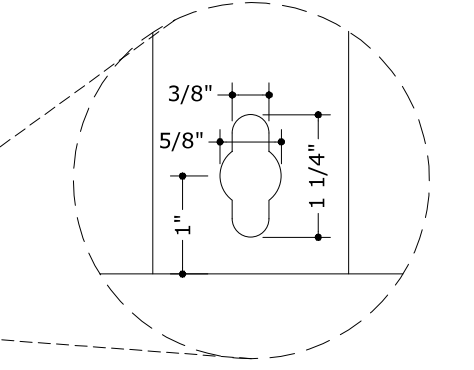


3 KEYHOLE PUNCH
1 6" = 1'-0" ELEV

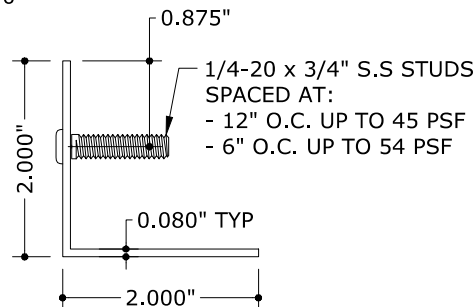


2 STUDDED ANGLE
6" = 1'-0"




3 KEYHOLE WASHER
6" = 1'-0"

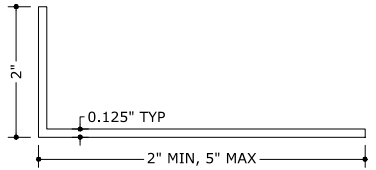


4 ALUMINUM CLOSURE
4" = 1'-0"

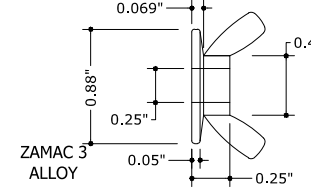

6 WASHERED WING NUT
NTS

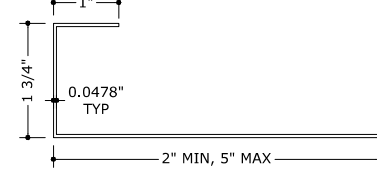

5 STEEL J-PAN CLOSURE
4" = 1'-0"

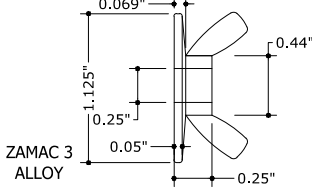

7 WIDE BASE WASHERED WING NUT
NTS

GENERAL NOTES:

- 1) THIS SYSTEM HAS BEEN TESTED AND EVALUATED AS A LARGE MISSILE IMPACT PROTECTIVE SYSTEM IN ACCORDANCE WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE SEVENTH EDITION (2020), THE INTERNATIONAL BUILDING CODE (IBC) AND THE INTERNATIONAL BUILDING CODE (IRC) CURRENT EDITION, FOR USE OUTSIDE THE HIGH VELOCITY HURRICANE ZONE PER ASTM STANDARDS E330, E1886, & E1996 SEE PRODUCT EVALUATION REPORT FOR ADDITIONAL INFORMATION.
- 2) NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS PRODUCT. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
- 3) POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED PER SEPARATE ENGINEERING IN ACCORDANCE WITH THE GOVERNING CODE. PRESSURE REQUIREMENTS AS DETERMINED IN ACCORDANCE WITH ASCE 7 AND CHAPTER 1609 OF THE FLORIDA BUILDING CODE SEVENTH EDITION (2020) SHALL BE LESS THAN OR EQUAL TO THE POSITIVE OR NEGATIVE DESIGN PRESSURE CAPACITY VALUES LISTED HEREIN FOR ANY ASSEMBLY AS SHOWN.
- 4) THIS SYSTEM HAS BEEN DESIGNED WITH NO SEPARATION FROM GLAZING REQUIRED FOR WIND ZONES 1-3 IN ACCORDANCE WITH ASTM E1996. IT IS ACCEPTABLE BY CODE UNLESS OPTIONAL CRITERIA IS INDEPENDENTLY ADOPTED BY THE AUTHORITY HAVING JURISDICTION.
- 5) DESIGN PRESSURES NOTED HEREIN ARE BASED ON MAXIMUM TESTED PRESSURES DIVIDED BY A 1.5 SAFETY FACTOR.
- 6) THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. IF SITE CONDITIONS DEVIATE FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS TO BE USED IN CONJUNCTION WITH THIS DOCUMENT.
- 7) THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS IS OUTSIDE THE SCOPE OF THIS CERTIFICATION AND SHALL BE VERIFIED BY OTHERS.
- 8) CLEAR POLYCARBONATE PANELS SHALL BE ALTERNATED WITH 0.018" (MIN) GALV STEEL PANELS SUCH THAT NO TWO POLYCARBONATE PANELS ARE ADJACENT TO EACH OTHER.
- 9) No. 3 KEYHOLE WASHER REQUIRED ONLY WHEN 7/8" Ø WASHERED WING NUT No. 6 IS USED. WHEN LARGE WASHERED WING NUT No. 7 IS USED, THE No. 3 KEYHOLE WASHER IS NOT REQUIRED.
- 10) ALL GALV STEEL STORM PANELS SHALL HAVE MIN GALVANIZED THICKNESS t=0.018" CONFORMING TO ASTM A653, STRUCTURAL QUALITY GRADE 40, WITH G60 GALVANIZED COATING AND MIN Fy=44.58 KSI.
- 11) CLEAR POLYCARBONATE STORM PANELS WITH 12.5" COVERAGE SHALL BE MFD BY TRANSPARENT PROTECTION SYSTEMS, Inc., AND THOSE WITH 6.25" COVERAGE SHALL BE MANUFACTURED BY TOWN & COUNTRY INDUSTRIES, Inc. ALL POLYCARB PANELS SHALL BE EXTRUDED WITH THICKNESS t=0.100" (±0.010") AND SHALL BE MANUFACTURED FROM 100% SYNTHETIC THERMOPLASTIC POLYMER RESIN (UV STABILIZED). TYPICAL TENSILE STRENGTH Fy=8.908 KSI, FLEXURAL STRENGTH Fby=12.90 KSI, & FLEXURAL MODULUS IS 328.7 KSI.
- 12) ALL EXTRUSIONS SHALL BE 6063-T6 ALUMINUM ALLOY, UNLESS NOTED OTHERWISE.
- 13) PANELS SHALL BE PERMANENTLY LABELED WITH A MINIMUM OF ONE LABEL PER PANEL AS FOLLOWS:
TOWN & COUNTRY INDUSTRIES
FT. LAUDERDALE, FL
ASTM E1886, E1996 & E330 9 LB MISSILE LEVEL D
FLORIDA PRODUCT APPROVAL NUMBER
- 14) STORM PANELS HAVE BEEN DESIGNED AND TESTED TO THE MAXIMUM SPANS AND LOADS SHOWN ON THESE DRAWINGS. REFERENCE CONSTRUCTION TESTING CORPORATION (CTC OF MIAMI, FL) TEST REPORTS #04-004, #04-005, & #04-006.
- 15) TOP & BOTTOM DETAILS SHOWN MAY BE INTERCHANGED AS FIELD CONDITIONS DICTATE. PANELS MAY BE MOUNTED HORIZONTALLY WHERE APPLICABLE.
- 16) ALL BOLTS & WASHERS SHALL BE ZINC COATED STEEL, GALVANIZED STEEL OR STAINLESS STEEL WITH A MINIMUM TENSILE YIELD STRENGTH OF 33 KSI.

VISIT [ECALC.IO/26148](https://ecalculator.com/26148)

FOR SITE SPECIFIC DEVIATIONS
& MORE INFORMATION ABOUT THIS DOCUMENT
OR SCAN THIS QR CODE

VISIT [ENGINEERINGEXPRESS.COM/STORE](https://engineeringexpress.com/store)
FOR ADDITIONAL PLANS, REPORTS & RESOURCES



FRANK BENNARDO, PE
PE# 0046549 CA#9885

ENGINEERING EXPRESS
CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM

Town & Country INDUSTRIES
Wholesale Aluminum and Building Products
A Division of AEC Supply Co., Inc.

400 WEST MCNAB ROAD
FT. LAUDERDALE, FL 33309
FL12856.2

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CL	FLB	9/22/05
2007 FBC	RKB	CSL	12/30/08
2010 FBC (05-TOM-0001)	KL	FLB	12/15/11
2014 FBC	RWN	CSL	3/20/15
2017 FBC	RWN	FLB	8/1/17
2020 FBC UPDATE	CB	RWN	6/17/20

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF FRANK L. BENNARDO, P.E. * ALTERATIONS, ADDITIONS, HIGHLIGHTING OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.


20-26148

SCALE: -

PAGE DESCRIPTION:

1

C:\Users\rickn\Engineering\Express\Production - Documents\Projects\20-26148 - FL12856.2 - Safety Edge Storm Panels\WP12856.2 - DWG.dwg
10/06/2020 - 5:17pm
rickn

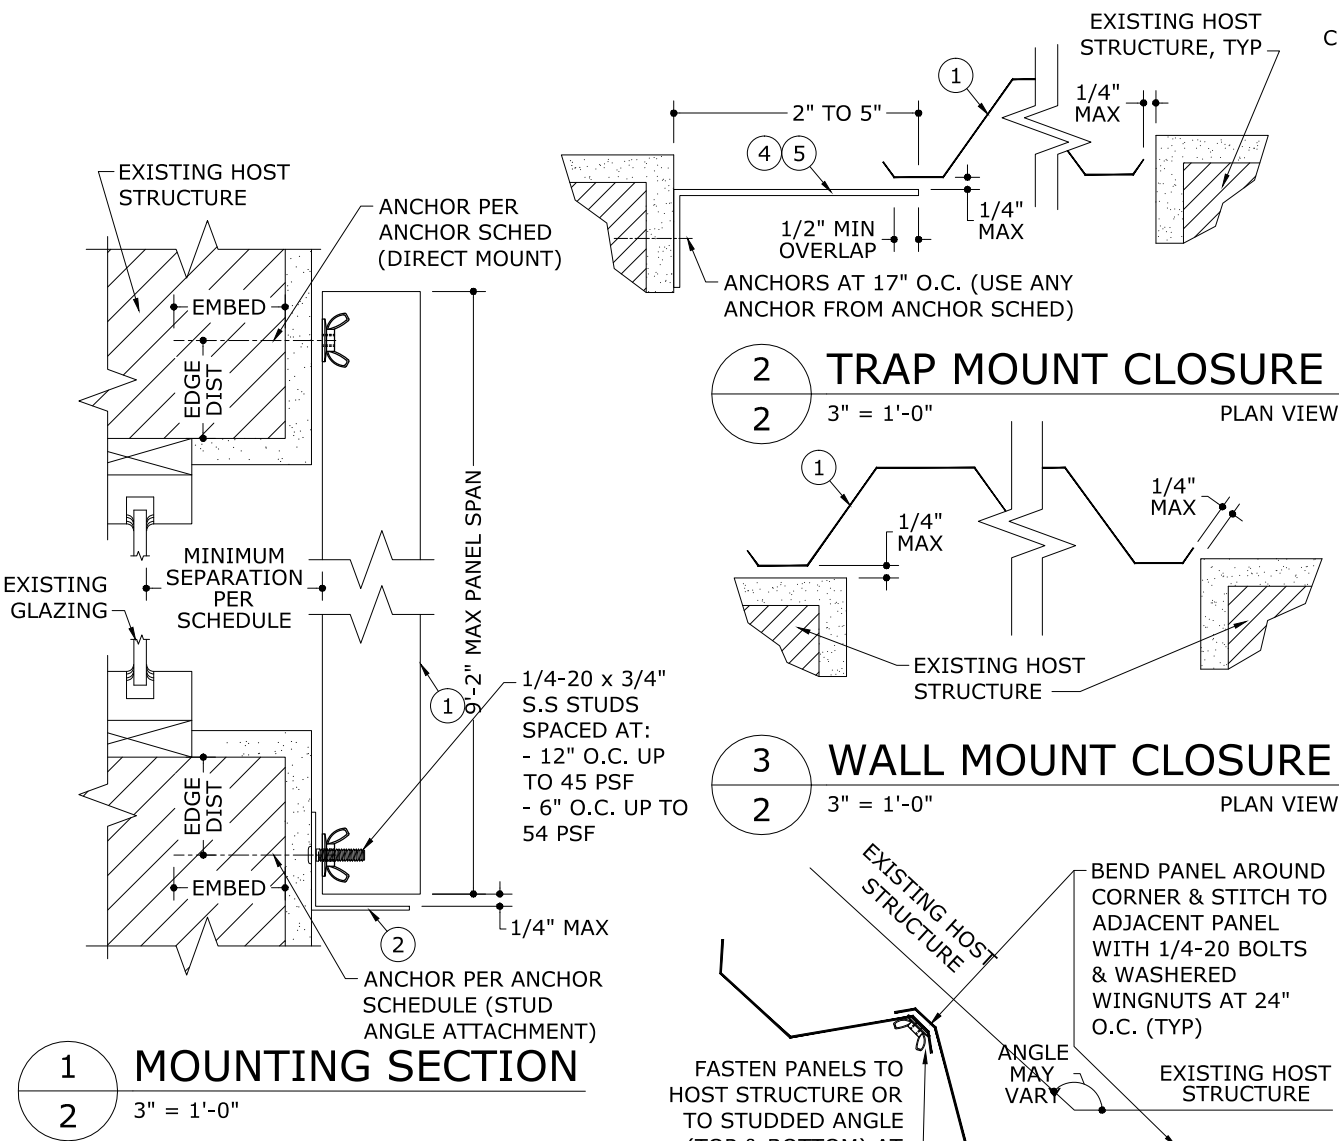

SPAN SCHEDULE

28ga (0.018") GALV STEEL PANELS

MAX LOAD: ±54.0 psf
MAX SPAN: 9'-2" (ALL MOUNTING CONDITIONS)
MIN SPANS: 26" (DIRECT MOUNT TOP & BOTTOM)
16" (ALL OTHER CONDITIONS)

0.100" CLEAR POLYCARB FULL-/HALF-PANELS

MAX LOAD: ±54.0 psf
MAX SPAN: 9'-2" (ALL MOUNTING CONDITIONS)
MIN SPANS: 24" (DIRECT MOUNT TOP & BOTTOM)
15" (ALL OTHER CONDITIONS)

GLASS SEPARATION SCHEDULE NOTES:

- GLASS SEPARATION SCHEDULE PROVIDES MINIMUM SEPARATION DISTANCE REQUIRED BETWEEN EXTERIOR FACE OF GLAZING (OR OTHER PRODUCT BEING PROTECTED) AND INTERIOR FACE OF INSTALLED STORM PANEL.
- SEPARATION DISTANCE PER THIS SCHEDULE IS REQUIRED FOR USE WITH POSITIVE LOADS ONLY.
- SEPARATION FROM GLASS IS NOT REQUIRED FOR INSTALLATIONS IN WIND ZONES 1-3 UNLESS LOCAL MUNICIPALITY HAS ADOPTED ADDITIONAL CRITERIA.


GLASS SEPARATION SCHEDULE

28ga (0.018") GALV STEEL PANELS


- MIN. GLASS SEPARATION FOR INSTALLATIONS AT OR BELOW 30' ABOVE GRADE: 5.375"
- MIN. GLASS SEPARATION FOR INSTALLATIONS GREATER THAN 30' ABOVE GRADE: 5.375"

0.100" CLEAR POLYCARB FULL-/HALF-PANELS


- MIN. GLASS SEPARATION FOR INSTALLATIONS AT OR BELOW 30' ABOVE GRADE: 7.350"
- MIN. GLASS SEPARATION FOR INSTALLATIONS GREATER THAN 30' ABOVE GRADE: 5.375"

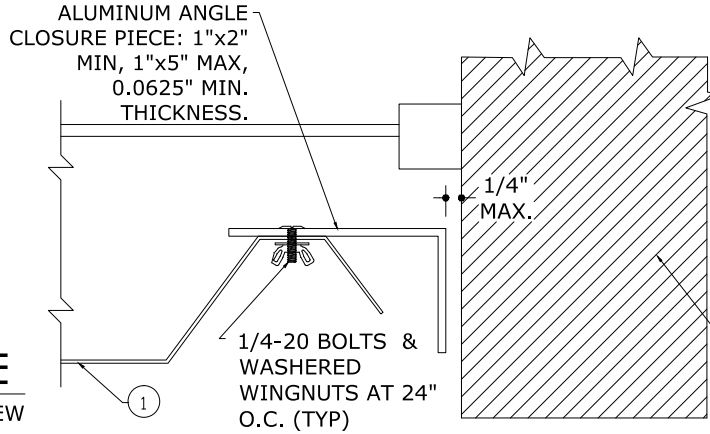

ALT. TRAP MOUNT CLOSURE DETAIL

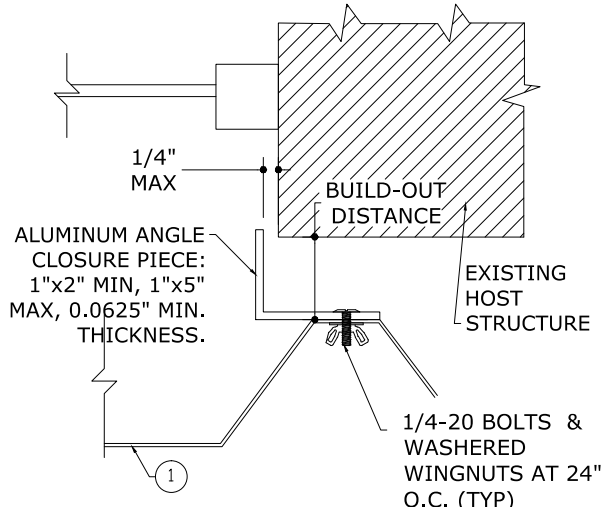


BUILD-OUT MOUNT CLOSURE DETAIL

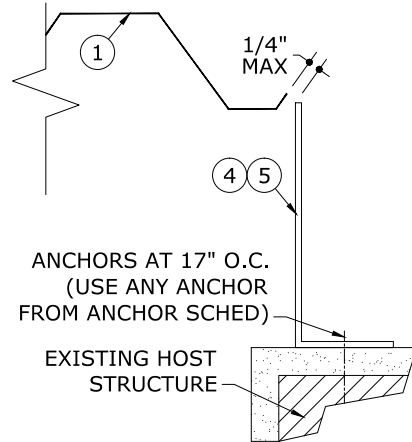

BUILD-OUT MOUNT CLOSURE

5 2 3" = 1'-0" PLAN VIEW

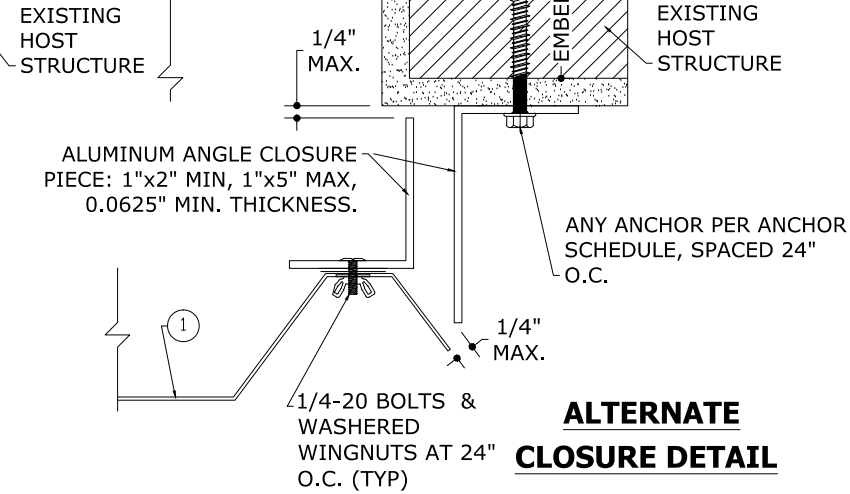

ANCHOR SCHEDULE NOTES:

- "DEWALT PANELMATE" ANCHORS MAY BE DEWALT FEMALE PANELMATE OR ELCO PANELMATE PLUS, AS ILLUSTRATED.
- ENSURE MINIMUM 2" EDGE DISTANCE FOR ANCHORS TO CONCRETE & TO HOLLOW BLOCK, U.N.O. EDGE DISTANCE OF 3/4" IS ACCEPTABLE FOR ANCHORS TO WOOD.
- MINIMUM EMBEDMENT SHALL BE AS NOTED IN ANCHOR SCHEDULE. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
- ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
- ALL CONCRETE ANCHORS SPECIFIED HEREIN SHALL BE INSTALLED TO NON-CRACKED CONCRETE ONLY. ALL BLOCK SUBSTRATES SHALL BE ASTM C-90 MINIMUM.
- WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT PLYWOOD.
- WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x4 (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING). WOOD STUD SHALL BE "SOUTHERN PINE" G=0.42 OR GREATER DENSITY, UNLESS OTHERWISE NOTED.
- ANCHOR SCHEDULE APPLIES FOR ALL PRODUCTS CERTIFIED HEREIN, BUT ONLY PROVIDES MAXIMUM ALLOWABLE ANCHOR SPACING. MAXIMUM ALLOWABLE SPANS AND PRESSURES INDICATED IN SPAN SCHEDULE SHALL APPLY.
- MACHINE SCREWS SHALL HAVE MINIMUM OF 1/2" ENGAGEMENT OF THREADS IN BASE ANCHOR AND MAY HAVE EITHER A PAN HEAD, TRUSS HEAD, OR WAFER HEAD ("SIDEWALK BOLT") U.N.O.
- ALL 1/4" EA MALE BOLTS MAY USE THE OPTIONAL FEMALE CAP SHOWN BELOW AT THE ANCHOR SPACINGS LISTED

OPTIONAL FEMALE CAP

FRANK BENNARDO, PE
PE# 0046549 CA#9885



ENGINEERING
EXPRESS

CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM

Town & Country
INDUSTRIES
Wholesale Aluminum and Building Products
A Division of AEC Supply Co., Inc.
400 WEST MCNAB ROAD
FT. LAUDERDALE, FL 33309
FL12856.2

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CL	FLB	9/22/05
2007 FBC	RKB	CSL	12/30/08
2010 FBC (05-TOM-0001)	KL	FLB	12/15/11
2014 FBC	RWN	CSL	3/20/15
2017 FBC	RWN	FLB	8/1/17
2020 FBC UPDATE	CB	RWN	6/17/20

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF FRANK L. BENNARDO, P.E. * ALTERATIONS, ADDITIONS, HIGHLIGHTING OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

COPYRIGHT FRANK L. BENNARDO P.E.

20-26148

SCALE: -
PAGE DESCRIPTION:

2



ANCHOR SCHEDULE (STUD ANGLE ATTACHMENT)

HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 6'-8"	Spans Up To 7'-6"	Spans Up To 9'-2"
CONCRETE	1/4" ITW S.S. TAPCON W/ 1-3/4" EMBED, 1-1/4" EDGE DIST. (3192psi MIN CONC) 	33	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"
		47	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	16.0"	16.0"
	1/4" DEWALT ULTRACON 1-3/4" EMBED, 1" MIN. EDGE DIST. (2846psi MIN CONC) 	33	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"
		47	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	16.0"	16.0"
	1/4" ALL POINTS SOLID-SET ANCHOR x 7/8" EMBED & 1-1/4" MIN EDGE DIST (3000psi MIN CONC) 	33	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"
		47	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	15.9"	15.9"
	1/4" MILLENIUM MILLFAST W/ 1-3/4" EMBED, 1" MIN. EDGE DIST. (3275 psi MIN CONC) 	33	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"
		47	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	16.0"	16.0"

HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 6'-8"	Spans Up To 7'-6"	Spans Up To 9'-2"
HOLLOW BLOCK	1/4" ITW S.S. TAPCON W/ 1-1/4" EMBED, 4" MIN. EDGE DIST. 	33	14.5"	11.9"	10.6"	7.9"
		38	12.6"	10.3"	9.2"	6.9"
		47	10.2"	8.4"	7.4"	5.6"
		54	8.9"	7.3"	6.5"	4.8"
	1/4" DEWALT ULTRACON W/ 1-1/4" EMBED, 1" MIN. EDGE DIST. 	33	16.0"	14.0"	13.1"	11.1"
		38	16.0"	13.5"	12.2"	9.6"
		47	14.3"	11.7"	10.4"	7.8"
		54	12.4"	10.2"	9.1"	6.8"
	1/4" ALL POINTS SOLID-SET ANCHOR x 7/8" EMBED, 2" MIN. EDGE DIST. 	33	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"
		47	16.0"	16.0"	16.0"	15.9"
		54	16.0"	15.1"	14.7"	13.9"
	1/4" MILLENIUM MILLFAST W/ 1-1/4" EMBED, 1" MIN. EDGE DIST. 	33	16.0"	14.9"	14.4"	13.3"
		38	16.0"	14.2"	13.3"	11.6"
		47	16.0"	13.3"	12.0"	9.4"
		54	14.9"	12.2"	10.9"	8.1"


HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 6'-8"	Spans Up To 7'-6"	Spans Up To 9'-2"
WOOD (G=0.55 MIN SPECIFIC GRAVITY)	1/4" ITW S.S. TAPCON OR ELCO ULTRACON OR #14 WOOD SCREW OR SMS x 2" EMBED 	33	16.0"	15.7"	15.5"	15.2"
		38	16.0"	14.9"	14.3"	13.2"
		47	16.0"	13.9"	12.8"	10.7"
		54	16.0"	13.3"	12.0"	9.3"
	1/4" LAG SCREW OR HANGER BOLT x 2" THREAD EMBED 	33	16.0"	15.8"	15.7"	15.5"
		38	16.0"	15.0"	14.5"	13.4"
		47	16.0"	13.9"	12.9"	10.9"
		54	16.0"	13.4"	12.1"	9.5"
	1/4" DEWALT PANELMATE (FEMALE, MALE, OR PLUS) W/ 1-7/8" MIN EMBED 	33	16.0"	15.7"	15.5"	15.2"
		38	16.0"	14.9"	14.3"	13.2"
		47	16.0"	13.9"	12.8"	10.7"
		54	16.0"	13.3"	12.0"	9.3"

HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 6'-8"	Spans Up To 7'-6"	Spans Up To 8'-4"	Spans Up To 9'-2"
WOOD (G=0.42 MIN SPECIFIC GRAVITY)	1/4" ITW S.S. TAPCON OR DEWALT ULTRACON OR #14 WOOD SCREW OR SMS x 2" EMBED 	33	16.0"	14.9"	14.6"	13.9"	13.1"
		38	16.0"	14.0"	13.3"	12.4"	12.0"
		47	16.0"	13.0"	12.0"	11.1"	10.4"
		54	15.1"	12.5"	11.3"	10.6"	9.3"
	1/4" LAG SCREW OR HANGER BOLT x 2" EMBED 	33	16.0"	15.7"	15.6"	15.4"	15.3"
		38	16.0"	14.9"	14.4"	13.8"	13.3"
		47	16.0"	13.9"	12.9"	11.8"	10.8"
		54	16.0"	13.3"	12.0"	10.7"	9.4"
	1/4" DEWALT PANELMATE (FEMALE, MALE, OR PLUS) W/ 1-7/8" MIN EMBED 	33	16.0"	15.7"	15.5"	15.4"	15.2"
		38	16.0"	14.9"	14.3"	13.8"	13.2"
		47	16.0"	13.9"	12.8"	11.8"	10.7"
		54	16.0"	13.3"	12.0"	10.7"	9.3"


HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 6'-8"	Spans Up To 7'-6"	Spans Up To 9'-2"
CONCRETE	1/4" EA MALE BOLT, 2-1/2" EMBED AND 2.5" MIN. EDGE DISTANCE (2900 PSI CONC) 	33	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"
		47	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	16.0"	16.0"
	1/4" EA MALE BOLT, 1-7/8" EMBED AND 2.5" MIN. EDGE DISTANCE (2900 PSI CONC) 	33	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"
		47	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	16.0"	16.0"
	1/4" EA MALE BOLT, 2-1/2" EMBED AND 1.25" MIN. EDGE DISTANCE (2900 PSI CONC) 	33	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"
		47	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	16.0"	16.0"



HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 6'-8"	Spans Up To 7'-6"	Spans Up To 9'-2"
HOLLOW BLOCK	1/4" EA MALE BOLT, 1-1/4" EMBED AND 1.25" MIN. EDGE DISTANCE 	33	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"
		47	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	16.0"	16.0"
	1/4" ITW "SAMMYS SSC" WITH 1-3/4" EMBED 	33	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"
		47	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	16.0"	16.0"

HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 6'-8"	Spans Up To 7'-6"	Spans Up To 9'-2"
WOOD (G=0.55 MIN.)	1/4" EA MALE BOLT, 1-1/2" EMBED AND 3/4" MIN. EDGE DISTANCE 	33	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"
		45	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	16.0"	16.0"
	1/4" EA MALE BOLT, 2" EMBED AND 3/4" MIN. EDGE DISTANCE 	33	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"
		45	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	16.0"	16.0"




HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 6'-8"	Spans Up To 7'-6"	Spans Up To 8'-4"	Spans Up To 9'-2"
WOOD G=0.42	1/4" EA MALE BOLT, 1-1/2" EMBED 	33	16.0"	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"	16.0"
		45	16.0"	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	16.0"	16.0"	16.0"
	1/4" EA MALE BOLT, 2" EMBED 	33	16.0"	16.0"	16.0"	16.0"	16.0"
		38	16.0"	16.0"	16.0"	16.0"	16.0"
		44	16.0"	16.0"	16.0"	16.0"	16.0"
		54	16.0"	16.0"	16.0"	16.0"	16.0"

ANCHOR SCHEDULE (DIRECT MOUNT)

HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 6'-8"	Spans Up To 7'-6"	Spans Up To 9'-2"
CONCRETE	1/4" PANELMATE (PLUS OR FEMALE) x 1-3/4" EMBED (3350psi MIN CONC) 	33	12.0"	12.0"	12.0"	12.0"
		38	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"
		54	6.0"	6.0"	6.0"	6.0"
	1/4" ITW "SAMMYS SSC" WITH 1-3/4" EMBED (3295psi MIN CONC) 	33	12.0"	12.0"	12.0"	12.0"
		38	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"
		54	6.0"	6.0"	6.0"	6.0"
	1/4" ALL POINTS SOLID-SET ANCHOR x 7/8" EMBED & 1-1/4" MIN EDGE DIST (3000psi MIN CONC) 	33	12.0"	12.0"	12.0"	12.0"
		38	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"
		54	6.0"	6.0"	6.0"	6.0"

HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 6'-8"	Spans Up To 7'-6"	Spans Up To 9'-2"
HOLLOW BLOCK	1/4" PANELMATE (PLUS OR FEMALE) x 1-3/4" EMBED (3350psi MIN CONC) 	33	12.0"	12.0"	12.0"	12.0"
		38	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"
		54	6.0"	6.0"	6.0"	6.0"
	1/4" ITW "SAMMYS SSC" WITH 1-1/4" EMBED 	33	12.0"	12.0"	12.0"	12.0"
		38	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"
		54	6.0"	6.0"	6.0"	6.0"
	1/4" ALL POINTS SOLID-SET ANCHOR x 7/8" EMBED, 2" MIN. EDGE DIST. 	33	12.0"	12.0"	12.0"	12.0"
		38	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"
		54	6.0"	6.0"	6.0"	6.0"

HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 6'-8"	Spans Up To 7'-6"	Spans Up To 9'-2"
WOOD (G=0.55 MIN SPECIFIC GRAVITY)	1/4" ITW S.S. TAPCON OR DEWALT ULTRACON OR #14 WOOD SCREW OR SMS x 2" EMBED 	33	12.0"	12.0"	12.0"	12.0"
		38	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"
		54	6.0"	6.0"	6.0"	6.0"
	1/4" LAG SCREW OR HANGER BOLT x 2" EMBED 	33	12.0"	12.0"	12.0"	12.0"
		38	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"
		54	6.0"	6.0"	6.0"	6.0"
	1/4" DEWALT PANELMATE (FEMALE, MALE, OR PLUS) W/ 1-7/8" MIN EMBED 	33	12.0"	12.0"	12.0"	12.0"
		38	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"
		54	6.0"	6.0"	6.0"	6.0"

HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 6'-8"	Spans Up To 7'-6"	Spans Up To 8'-4"	Spans Up To 9'-2"
WOOD (G=0.42 MIN SPECIFIC GRAVITY)	1/4" ITW S.S. TAPCON OR DEWALT ULTRACON OR #14 WOOD SCREW OR SMS x 2" EMBED 	33	12.0"	12.0"	12.0"	12.0"	12.0"
		38	12.0"	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"
		54	6.0"	6.0"	6.0"	6.0"	6.0"
	1/4" LAG SCREW OR HANGER BOLT x 2" EMBED 	33	12.0"	12.0"	12.0"	12.0"	12.0"
		38	12.0"	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"
		54	6.0"	6.0"	6.0"	6.0"	6.0"
	1/4" DEWALT PANELMATE (FEMALE, MALE, OR PLUS) W/ 1-7/8" MIN EMBED 	33	12.0"	12.0"	12.0"	12.0"	12.0"
		38	12.0"	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"
		54	6.0"	6.0"	6.0"	6.0"	6.0"