


24GA STEEL STORM PANEL

FOR USE OUTSIDE THE HVHZ & WIND ZONE 4

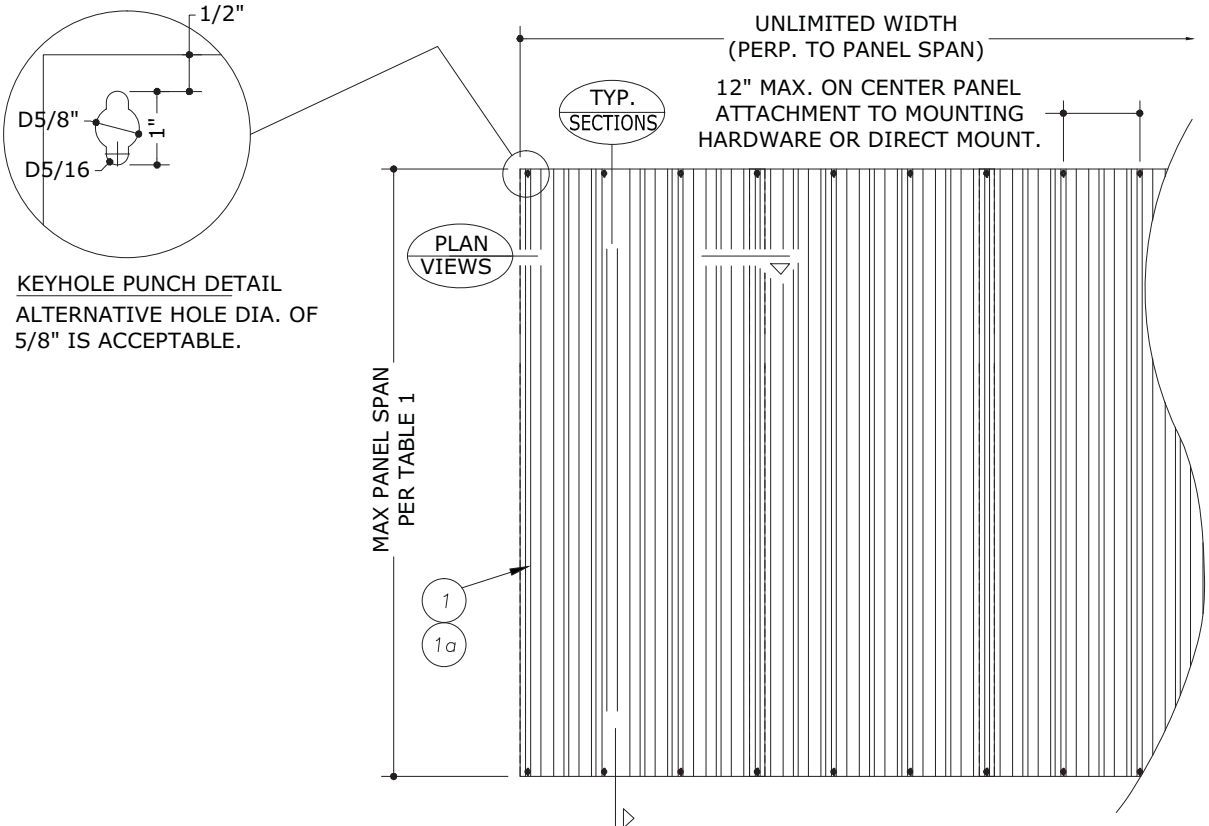

KEYHOLE PUNCH DETAIL
ALTERNATIVE HOLE DIA. OF
5/8" IS ACCEPTABLE.

NOTE: TOP MAY BE SLOPED OR RADIUSED TO MATCH GEOMETRY OF
OPENING. MOUNTING HARDWARE MUST BE ROLL-FORMED TO THE RADIUS;
NO NOTCHING OF MOUNTING HARDWARE TO ACHIEVE SHAPES IS ALLOWED.

TYPICAL ELEVATION WITH STEEL PANELS ONLY

N.T.S.

EXTERIOR ELEV

GENERAL NOTES


1. THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED AS A LARGE MISSILE IMPACT PROTECTIVE SYSTEM IN ACCORDANCE WITH THE FLORIDA BUILDING CODE SEVENTH EDITION (2020), INTERNATIONAL BUILDING CODE (IBC) AND INTERNATIONAL RESIDENTIAL CODE (IRC) FOR USE OUTSIDE THE HIGH VELOCITY HURRICANE ZONE & WIND ZONE 4. SEE PRODUCT EVALUATION REPORT FOR MORE INFORMATION.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED PER SEPARATE ENGINEERING IN ACCORDANCE WITH THE GOVERNING CODE. PRESSURE REQUIREMENTS AS DETERMINED IN ACCORDANCE WITH ASCE 7 AND CHAPTER 1609 OF THE FLORIDA BUILDING CODE SEVENTH EDITION (2020)) SHALL BE LESS THAN OR EQUAL TO THE POSITIVE OR NEGATIVE DESIGN PRESSURE CAPACITY VALUES LISTED HEREIN FOR ANY ASSEMBLY AS SHOWN.
4. DESIGN PRESSURES NOTED HEREIN ARE BASED ON MAXIMUM TESTED PRESSURES DIVIDED BY A 1.5 SAFETY FACTOR.
5. THIS SYSTEM HAS BEEN DESIGNED WITH NO SEPARATION FROM GLAZING AND IS INTENDED FOR USE IN WIND ZONES 1-3 ONLY.
6. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
7. THESE INSTALLATION INSTRUCTIONS ARE PART OF A PRODUCT APPROVAL EVALUATION AND SHALL ONLY BE USED IN CONJUNCTION WITH THE EVALUATION REPORT SUBMITTED FOR THE SAME PRODUCT APPROVAL. USE OF THESE APPROVAL DOCUMENTS SHALL COMPLY WITH CHAPTER 61G15 OF THE FLORIDA ADMINISTRATIVE CODE
8. PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS. BRICK VENEER PER ASTM C62 (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER ANY APPLICABLE LOADS TO THE EXISTING HOST STRUCTURE.
9. STORM PANELS SHALL BE ASTM A653 GRADE 40 STEEL WITH G60 GALVANIZED COATING, TESTED THICKNESS 0.0232".
10. ALL POLYCARBONATE PANELS SHALL BE MANUFACTURED BY TRANSPARENT PROTECTION SYSTEMS, Inc.
11. ALL POLYCARB PANELS SHALL BE EXTRUDED WITH THICKNESS t=0.100" (±0.010") AND SHALL BE MANUFACTURED FROM 100% SYNTHETIC THERMOPLASTIC POLYMER RESIN (UV STABILIZED). TYPICAL TENSILE STRENGTH Fy=8.908 KSI, FLEXURAL STRENGTH Fby=12.90 KSI, & FLEXURAL MODULUS IS 328.7 KSI
12. ALL EXTRUSIONS SHALL BE 6063-T6 ALUMINUM ALLOY, UNLESS NOTED OTHERWISE. ALL TOLERANCES SHALL BE IN ACCORDANCE WITH ADM 2015.
13. TOP & BOTTOM DETAILS SHOWN MAY BE INTERCHANGED AS FIELD CONDITIONS DICTATE. PANELS MAY BE MOUNTED VERTICALLY OR HORIZONTALLY AS APPLICABLE.
14. PANELS SHALL BE PERMANENTLY LABELED WITH LABELS SPACED NOT MORE THAN EVERY THREE LINEAL FEET PER PANEL AND SHALL FACE THE EXTERIOR AND CONTAIN AT LEAST THE FOLLOWING:
TOWN & COUNTRY INDUSTRIES
FT. LAUDERDALE, FL
ASTM E330, E1886, & E1996 9 LB MISSILE LEVEL D
FLORIDA PRODUCT APPROVAL NUMBER
15. ALL BOLTS & WASHERS SHALL BE ZINC COATED STEEL, GALVANIZED STEEL, STAINLESS STEEL, OR 2024-T6 ALUMINUM ALLOY WITH A MINIMUM TENSILE YIELD STRENGTH OF 33 KSI, UNLESS OTHERWISE NOTED HEREIN.
16. CONTRACTOR IS RESPONSIBLE TO INSULATE OR PROTECT ALL MEMBERS FROM DISSIMILAR MATERIALS TO PREVENT ELECTROLYSIS.
17. SEALANT SHALL BE USED ON ANCHORS OR TRACKS WHEREVER WATER SEEPAGE IS POSSIBLE.



TABLE 1		
ALLOWABLE SPAN SCHEDULE (STEEL PANELS ONLY)		
PANEL SPAN	ALLOWABLE DESIGN PRESSURE	
120"	+ 35.0 PSF	- 38.0 PSF
114"	+ 39.2 PSF	- 41.1 PSF
108"	+ 44.2 PSF	- 44.7 PSF
106"	+ 46.0 PSF	- 46.0 PSF
102"	+ 49.7 PSF	- 49.7 PSF
96"	+ 56.1 PSF	- 56.1 PSF
90"	+ 63.9 PSF	- 63.9 PSF
84"	+ 73.4 PSF	- 73.4 PSF
78"	+ 85.2 PSF	- 85.2 PSF
72"	+ 100.0 PSF	- 100.0 PSF

TABLE 1 NOTES:

- LINEAR INTERPOLATION BETWEEN SHUTTER SPANS IS NOT PERMITTED. FOR SPANS BETWEEN THOSE INDICATED ABOVE, THE DESIGN PRESSURES FOR THE NEXT HIGHER SPAN SHALL BE USED.
- DESIGN PRESSURES NOTED IN TABLE 1 APPLY TO ALL MOUNTING AND ANCHORAGE CONDITIONS AND SHALL NOT BE EXCEEDED.

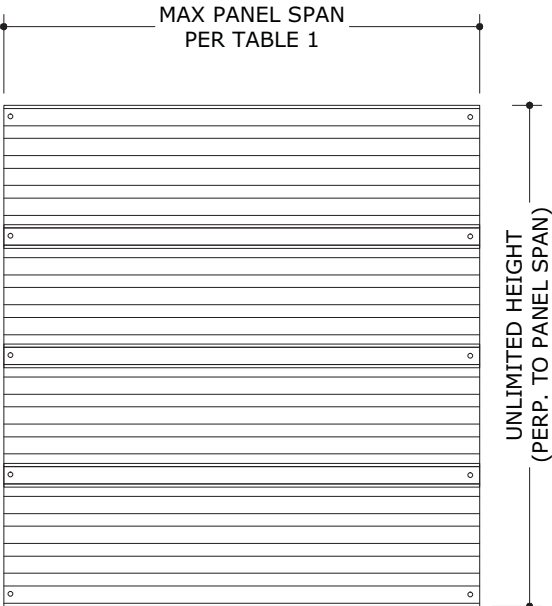

OPTIONAL HORIZONTAL MOUNT

N.T.S.

EXTERIOR ELEV

VISIT [ECALC.IO/26152](https://ecalculator.com/26152)

FOR SITE SPECIFIC DEVIATIONS
& MORE INFORMATION ABOUT THIS DOCUMENT
OR SCAN THIS QR CODE

VISIT [ENGINEERINGEXPRESS.COM/STORE](https://engineeringexpress.com/store)
FOR ADDITIONAL PLANS, REPORTS & RESOURCES



FRANK BENNARDO, PE
PE# 0046549 CA#9885



CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM

Town & Country
INDUSTRIES
Wholesale Aluminum and Building Products
A Division of AEC Supply Co., Inc.

400 WEST MCNAB ROAD
FT. LAUDERDALE, FL 33309
FL12856.3


REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CSL	FLB	4/01/15
2017 FBC	RWN	FLB	8/01/17
2020 FBC	CCB	RWN	6/17/20
THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. ANY UNAUTHORIZED REPRODUCTION OR TRANSMISSION OF THIS DOCUMENT IS PROHIBITED AND SHALL BE SUBJECT TO LEGAL ACTION. ANY ALTERATIONS, ADDITIONS, HIGHLIGHTS, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.			

COPYRIGHT FRANK L. BENNARDO P.E.


20-26152

SCALE: -
PAGE DESCRIPTION:

1 OF 10

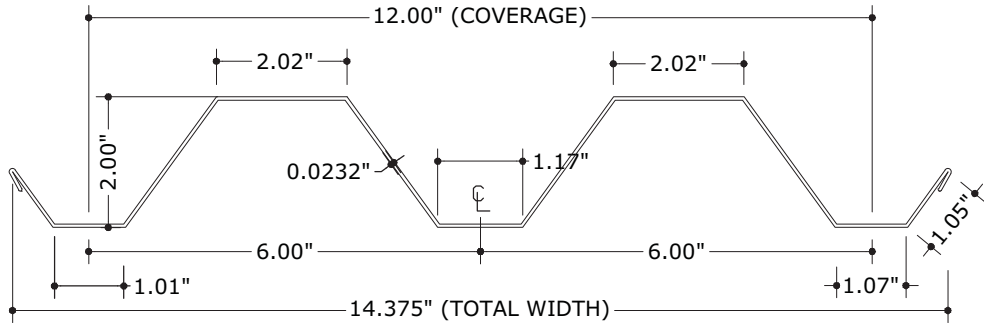


1 STEEL STORM PANEL

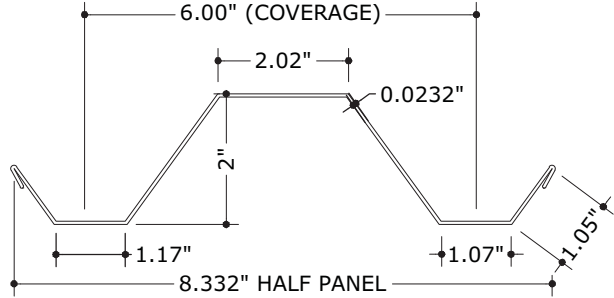


1a STEEL HALF STORM PANEL


NOTE: HALF STORM PANEL SHALL ONLY BE USED AS AN END PANEL TO CLOSE THE REMAINING OPENING THAT MAY BE LESS THAN FULL PANEL WIDTH

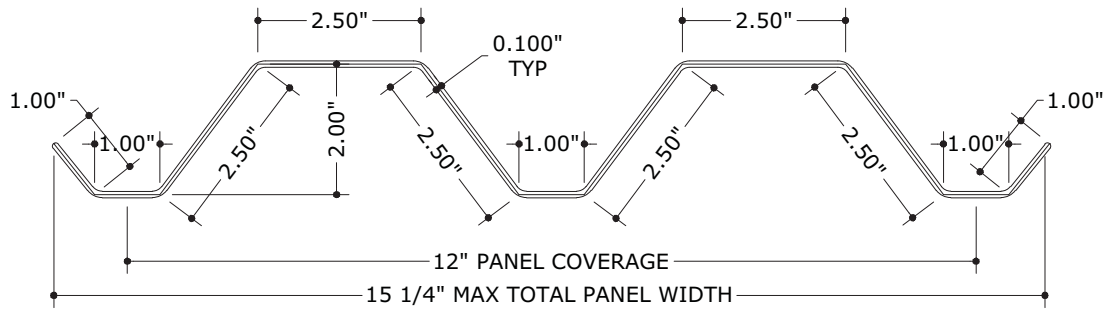


1b POLYCARBONATE STORM PANEL

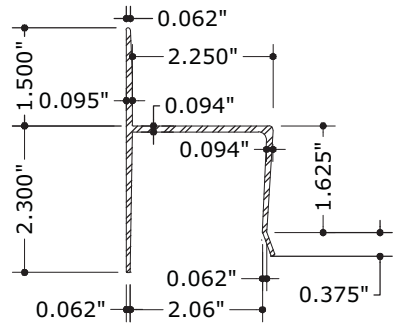


2 "H" HEADER

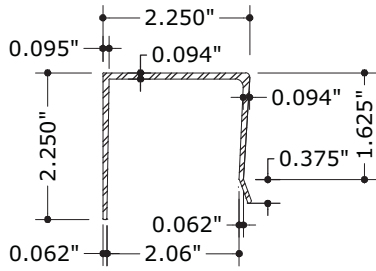

3 "U" HEADER

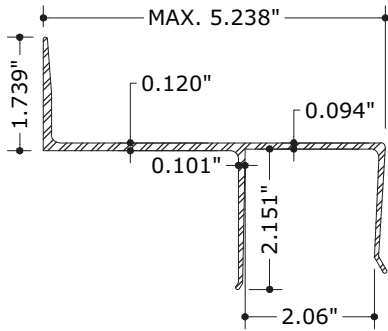


3a BUILD-OUT "U" HEADER

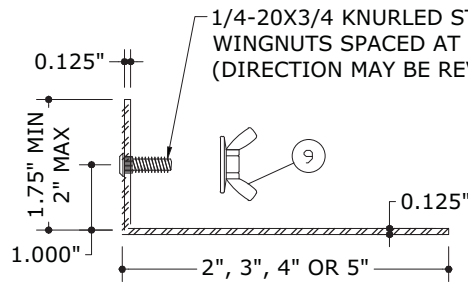


4 STUD ANGLE

SEE COMPONENT NOTES

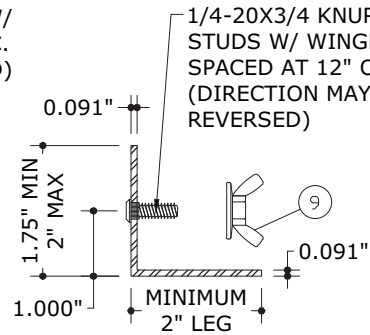


4a STUD ANGLE

SEE COMPONENT NOTES

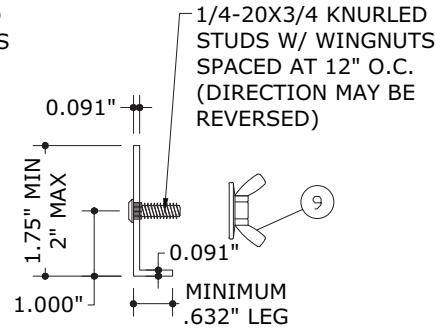


4b STUD ANGLE


SEE COMPONENT NOTES

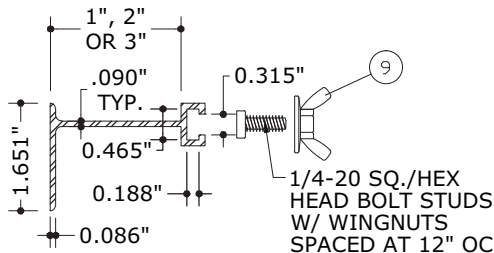

7 BUILD-OUT "F" TRACK

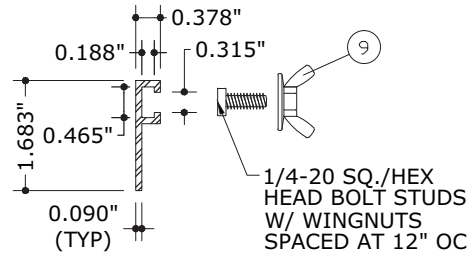


8 "F" TRACK

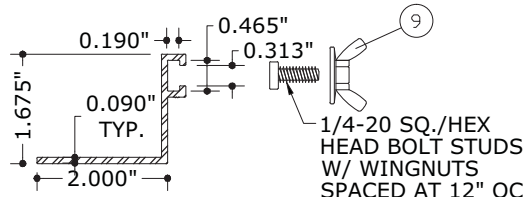


8a "F" ANGLE TRACK


(LEG DIRECTION MAY BE REVERSED)

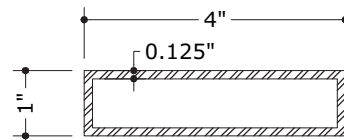

6 TUBE

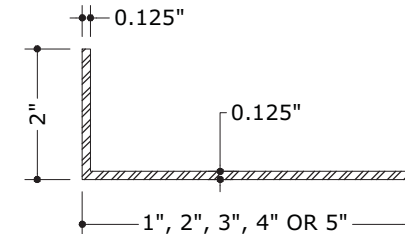


5 ANGLE




9 WASHER WINGNUT

NON-RECESSED FLAT SURFACE TYPE ONLY




10 KEYHOLE WASHER


20 GA. GALV. STEEL (t=.038")
GRADE 40 OR 0.050" ALUM
ALLOY (3004-H34)




11 1/4-20 SQ./HEX HEAD BOLT




12 1/4-20 316 SS MACHINE BOLT W/NUT



13 #14x3/4 SDS/SMS SCREW



14 1/4-20 SIDEWALK BOLT



15 1/4-20 TRUSS HEAD BOLT

REQUIRES USE OF KEYHOLE WASHER IN DIRECT MOUNT APPLICATIONS

COMPONENT NOTES
ANCHOR HEADS MUST NOT INTERFERE WITH INSTALLATION OF THE PANEL. THE FIRST AND LAST ANCHOR IN ALL TRACKS SHALL BE INSTALLED WITHIN THE FIRST 3" AND LAST 3", RESPECTIVELY. INSTALL ALL ANCHORS PER THE REQUIREMENTS LISTED IN THE ANCHOR SCHEDULE.

FRANK BENNARDO, PE
PE# 0046549 CA#9885



ENGINEERING
EXPRESS®

CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM

Town Country
INDUSTRIES
Wholesale Aluminum and Building Products
A Division of AEC Supply Co., Inc.

400 WEST MCNAB ROAD
FT. LAUDERDALE, FL 33309
FL12856.3


REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CSL	FLB	4/01/15
2017 FBC	RWN	FLB	8/01/17
2020 FBC	CCB	RWN	6/17/20
THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF FRANK L. BENNARDO, P.E. ANY ALTERATIONS, ADDITIONS, HIGHLIGHTS, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.			

COPYRIGHT FRANK L. BENNARDO P.E.


20-26152

SCALE: -
PAGE DESCRIPTION:


C:\Users\rickn\Engineering Express\Production - Documents\Projects\20-26152 - FL12856.3 - 24ga Steel Storm Panel\WP12020 FBC\20-26152c - FL12856.3 - DWG.dwg
09/30/2020 - 2:32pm
rickn

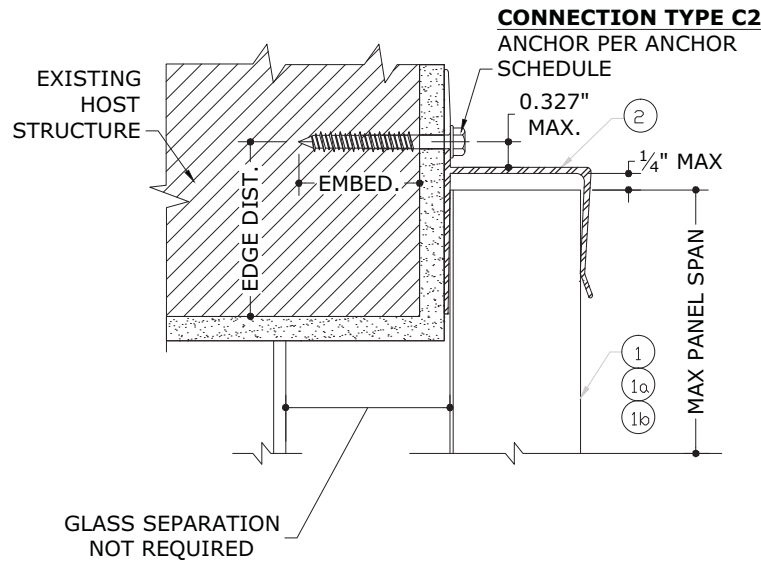


A "H" MOUNT SECTION

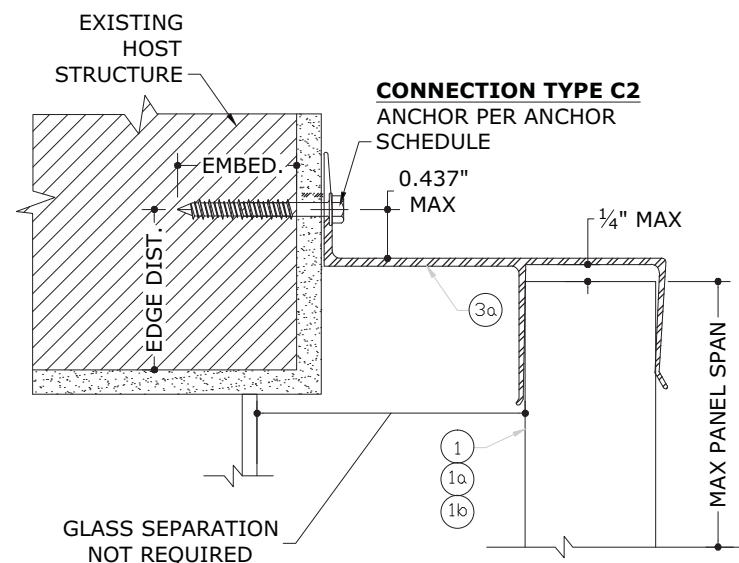


B BUILD-OUT "U" MOUNT SECTION

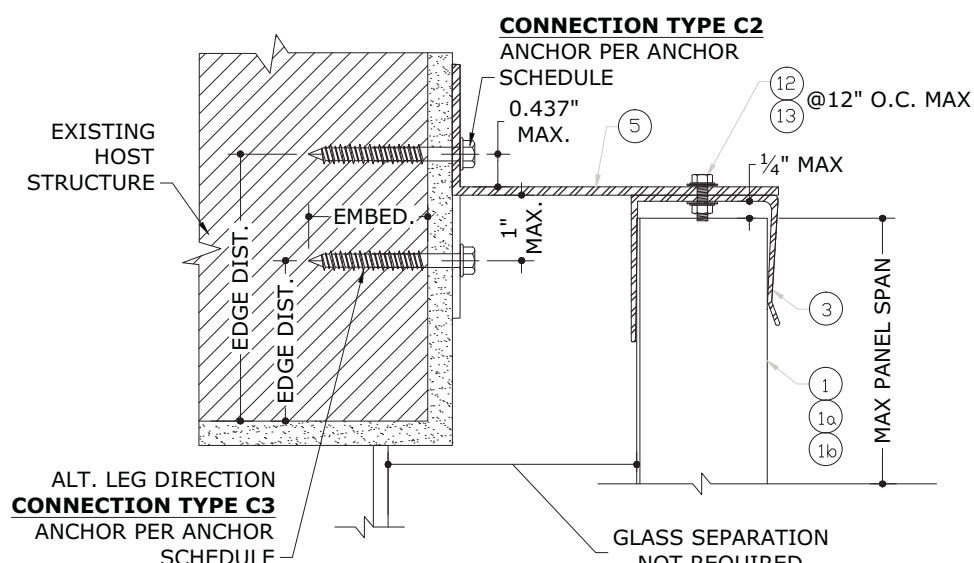


C ALT. BUILD-OUT "U" MOUNT SECTION

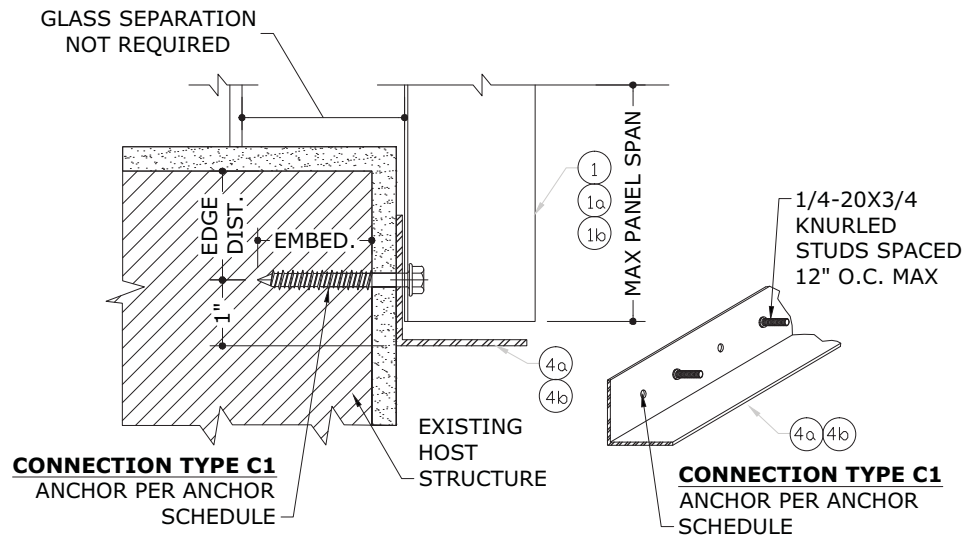


D STUD ANGLE WALL MOUNT SECTION

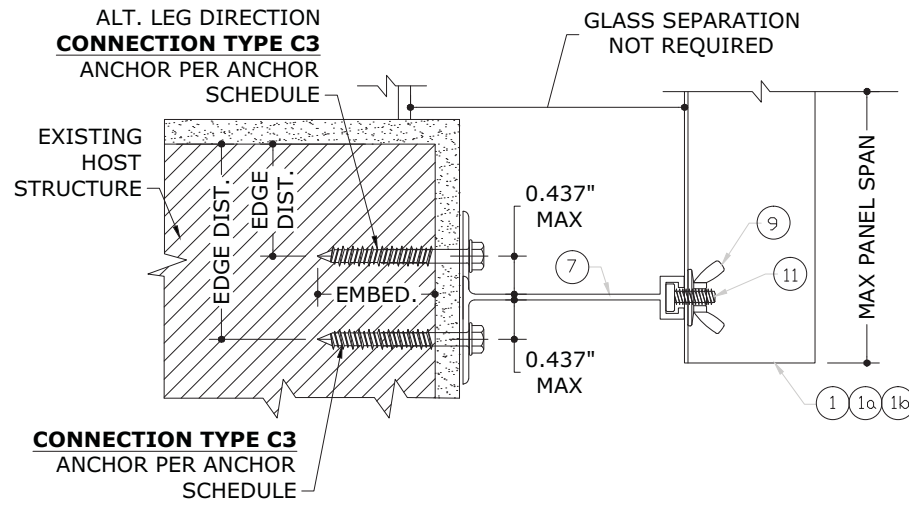


E BUILD-OUT "F" TRACK SECTION

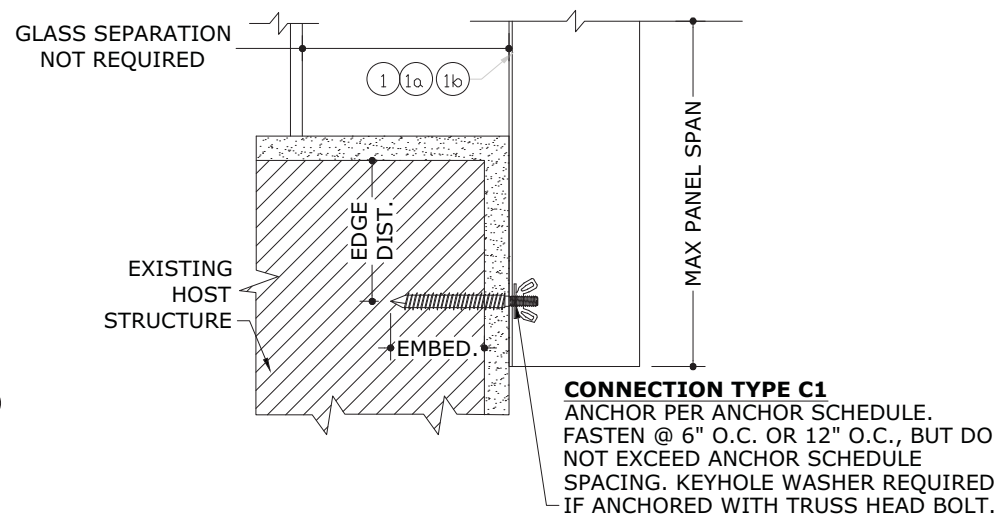


F DIRECT MOUNT SECTION

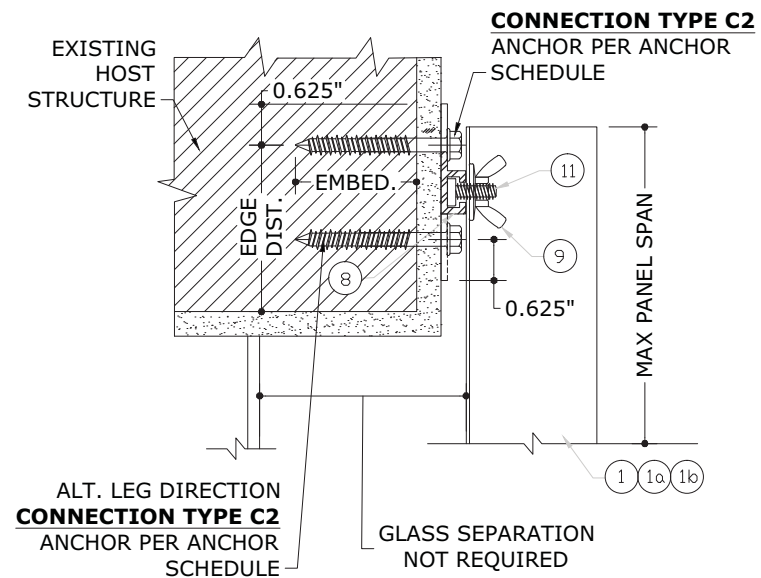

G "F" TRACK MOUNT SECTION

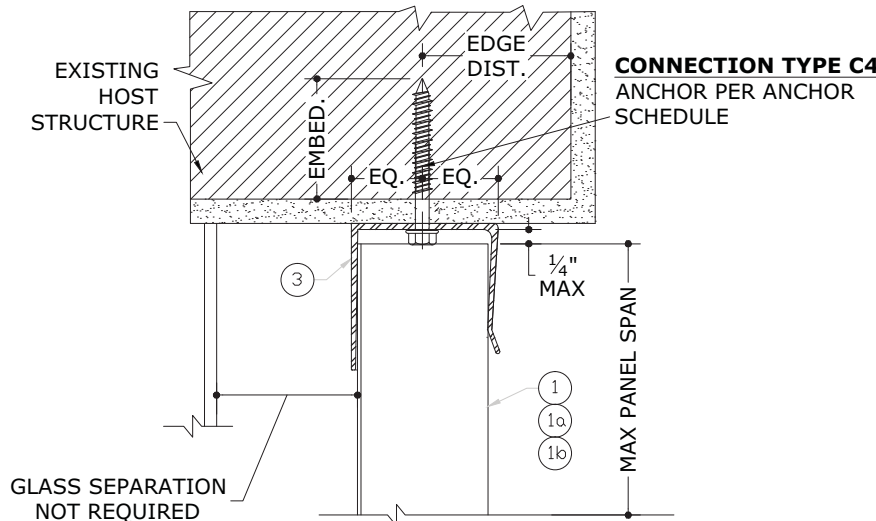

H TRAP "U" HEADER SECTION

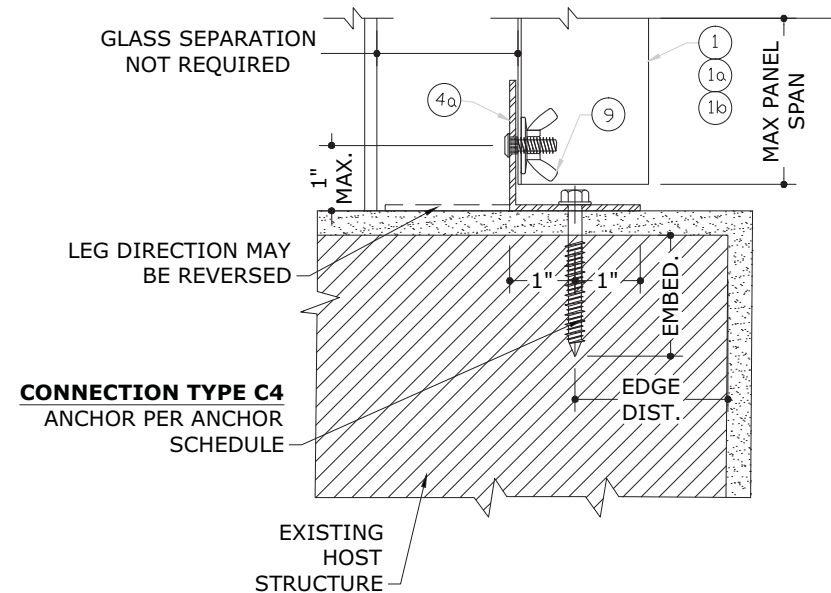

I TRAP STUD ANGLE SECTION

FRANK BENNARDO, PE
PE# 0046549 CA#9885



ENGINEERING
EXPRESS
CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM

Town Country
INDUSTRIES
Wholesale Aluminum and Building Products
A Division of AEC Supply Co., Inc.
400 WEST MCNAB ROAD
FT. LAUDERDALE, FL 33309
FL12856.3







REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CSL	FLB	4/01/15
2017 FBC	RWN	FLB	8/01/17
2020 FBC	CCB	RWN	6/17/20

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF FRANK L. BENNARDO, P.E. ANY ALTERATIONS, ADDITIONS, HIGHLIGHTS, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

COPYRIGHT FRANK L. BENNARDO P.E.

20-26152

SCALE: -
PAGE DESCRIPTION:

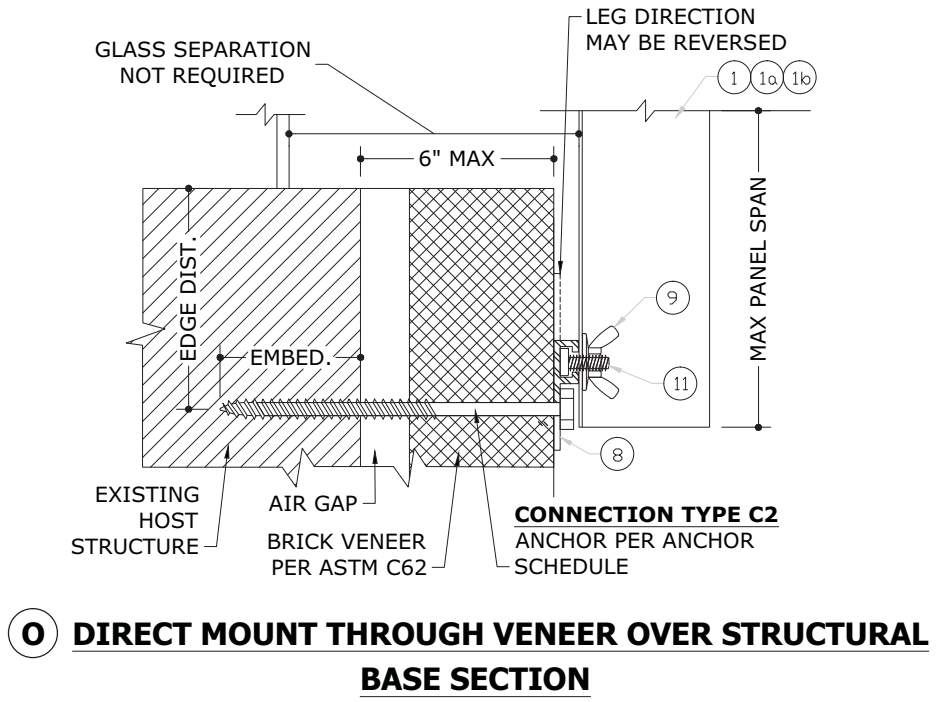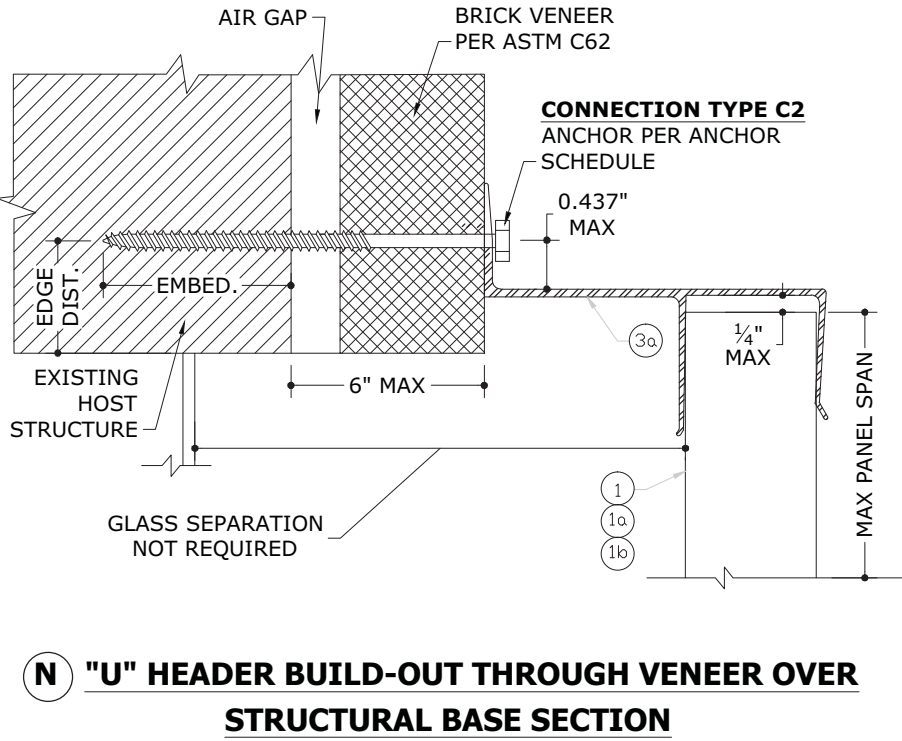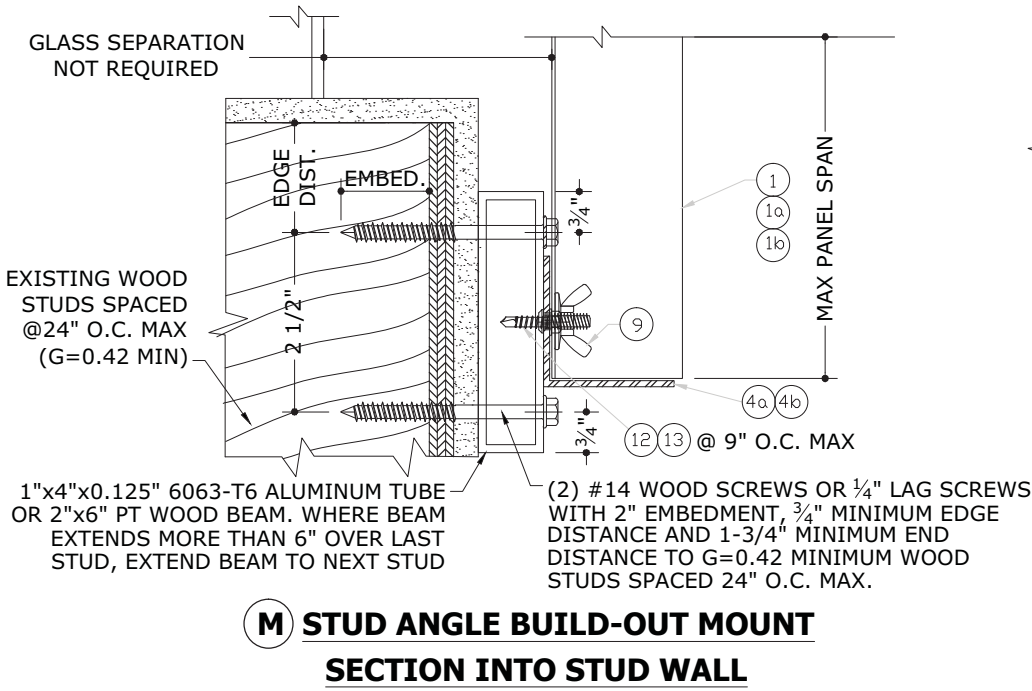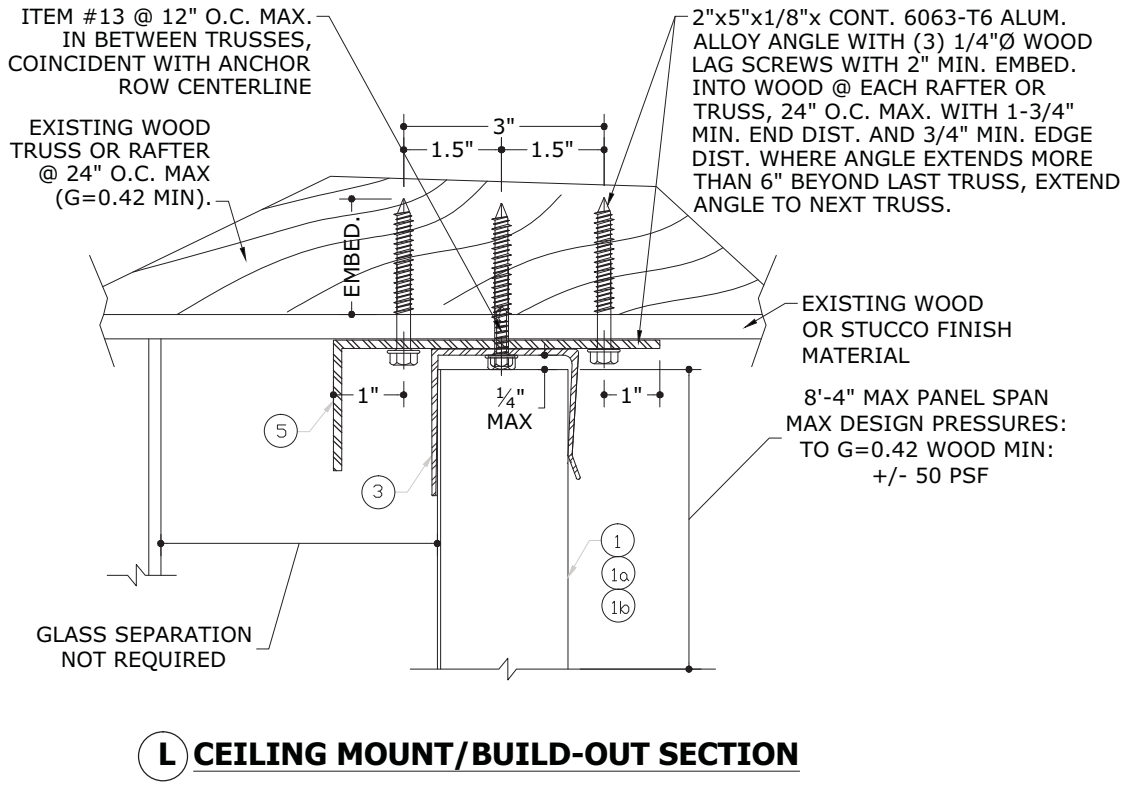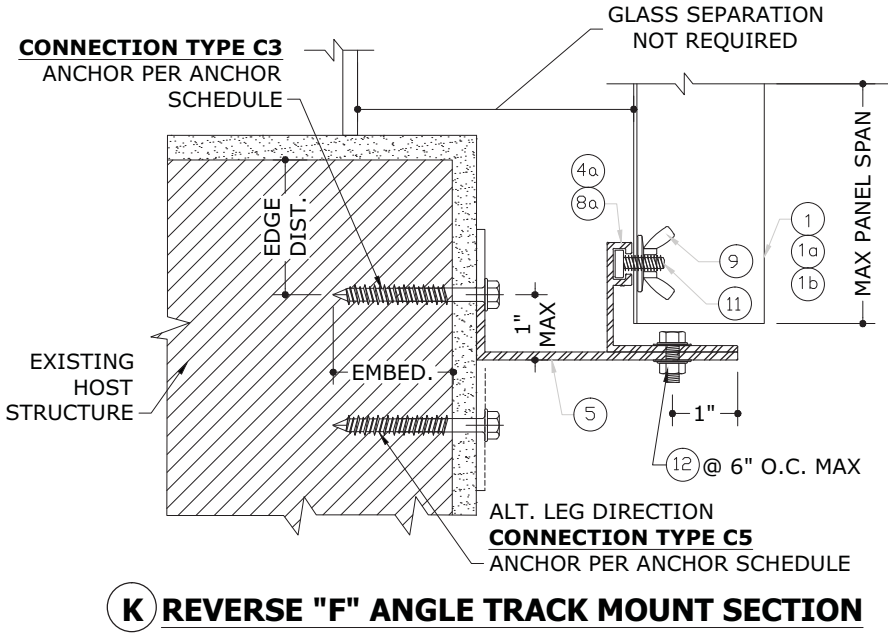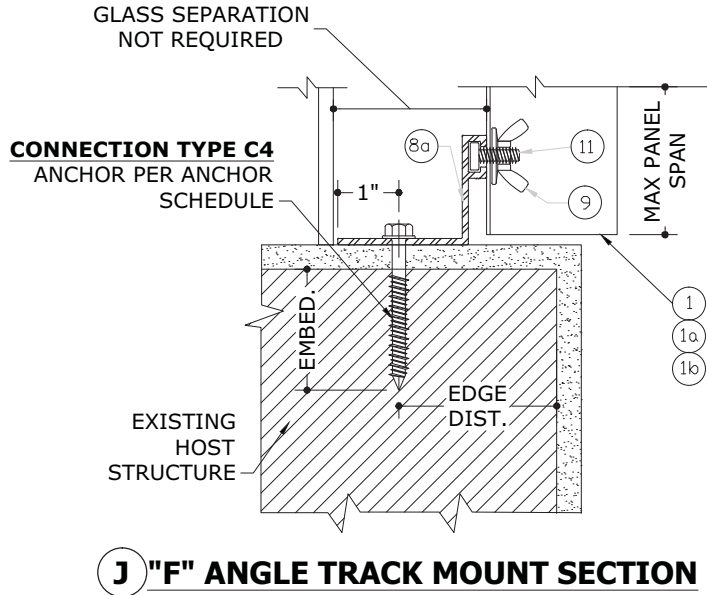

FRANK BENNARDO, PE
PE# 0046549 CA#9885

ENGINEERING
EXPRESS

CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM

Town & Country
INDUSTRIES
Wholesale Aluminum and Building Products
A Division of AEC Supply Co., Inc.

400 WEST MCNAB ROAD
FT. LAUDERDALE, FL 33309
FL12856.3

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CSL	FLB	4/01/15
2017 FBC	RWN	FLB	8/01/17
2020 FBC	CCB	RWN	6/17/20

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF FRANK L. BENNARDO, P.E. ANY ALTERATIONS, ADDITIONS, HIGHLIGHTS, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

COPYRIGHT FRANK L. BENNARDO P.E.

20-26152

SCALE: -


PAGE DESCRIPTION:

4


10

C:\Users\rickn\Engineering Express\Production - Documents\Projects\20-26152 - FL12856.3 - 24ga Steel Storm Panel\WP12020 FBC\20-26152c - FL12856.3 - DWG.dwg 09/30/2020 - 2:32pm rickn


C:\Users\rickn\Engineering Express\Production - Documents\Projects\20-26152 - FL12856.3 - 24ga Steel Storm Panel\WP\2020 FBC\20-26152c - FL12856.3 - DWG.dwg
09/30/2020 - 2:32pm
rickn

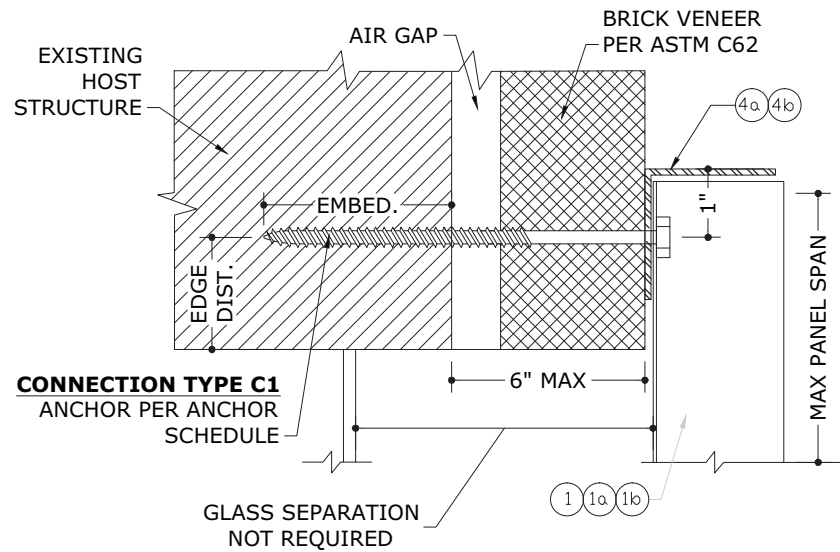


P STUD ANGLE THROUGH VENEER OVER STRUCTURAL BASE SECTION

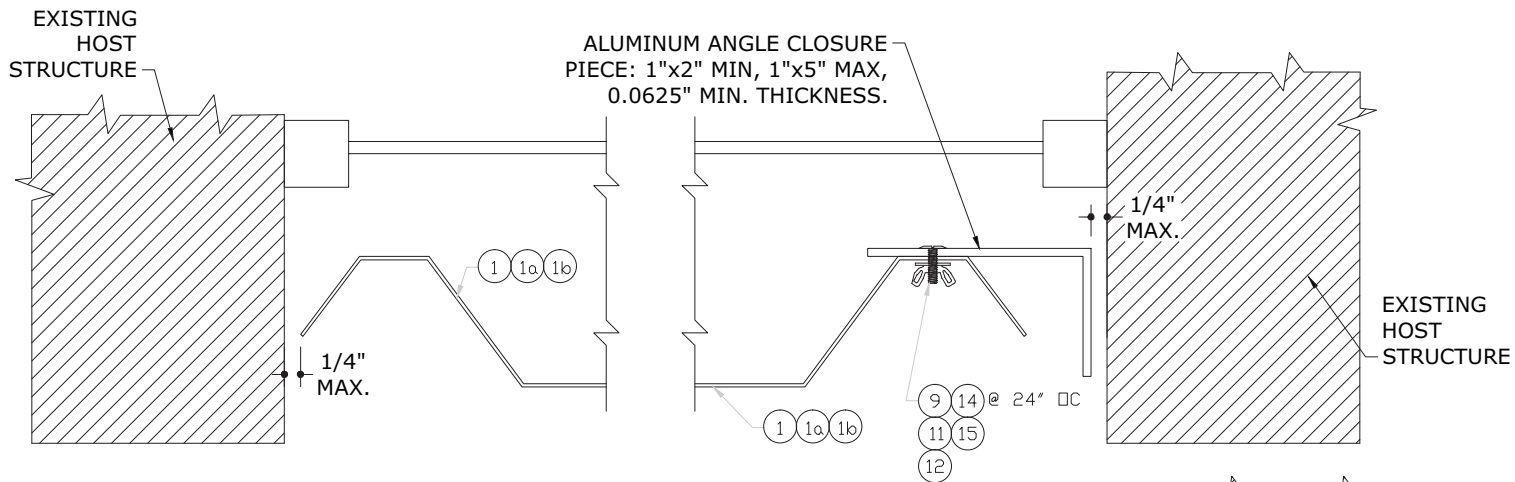


R TRAP MOUNT CLOSURE DETAIL

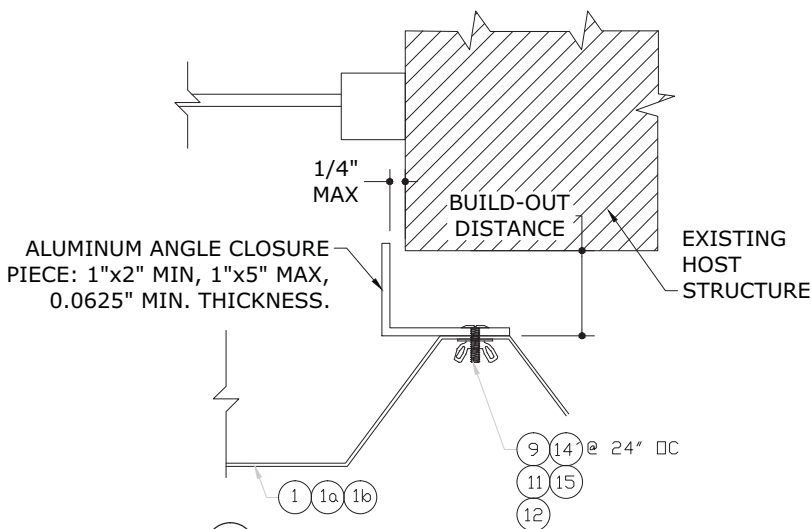


T BUILD-OUT MOUNT CLOSURE DETAIL

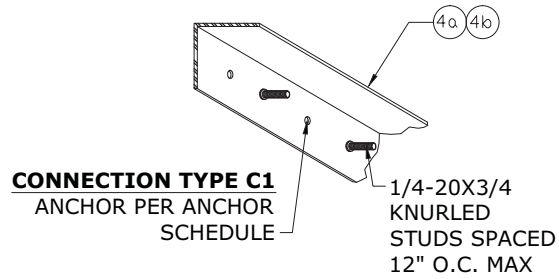


U ALTERNATE CLOSURE DETAIL

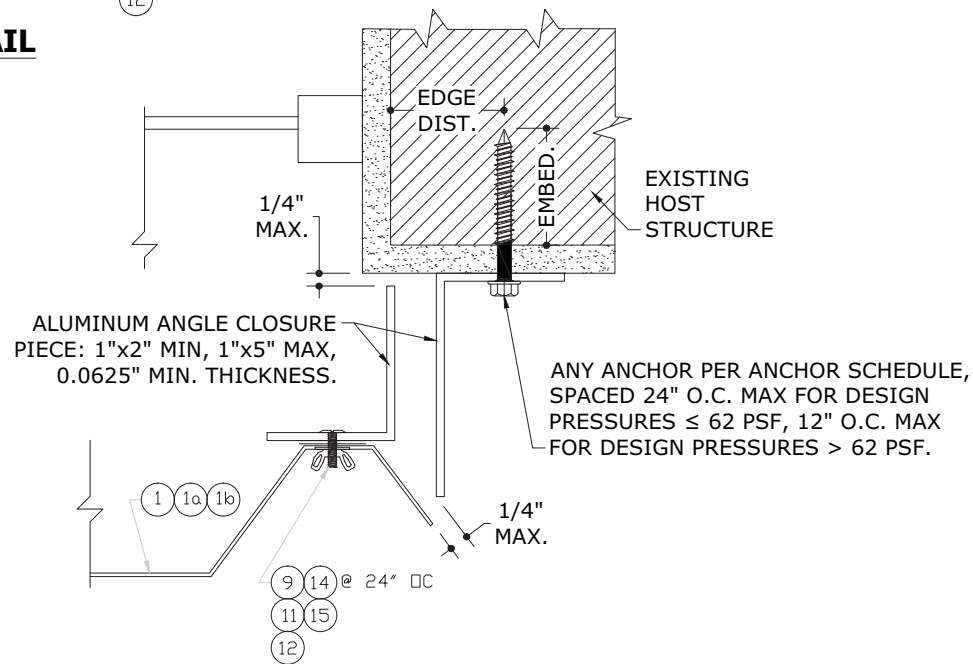


V CORNER ANGLE DETAIL

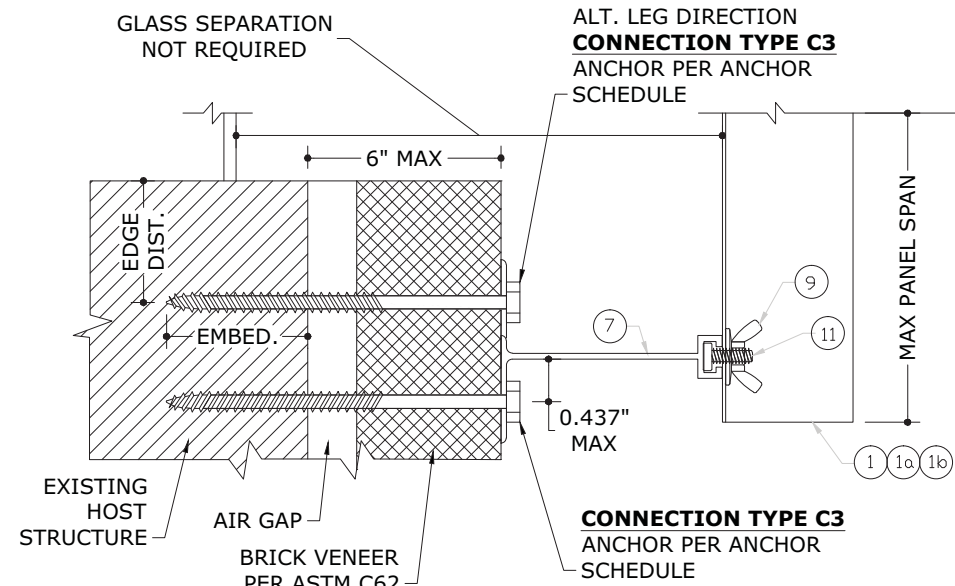

Q BUILD-OUT "F" TRACK THROUGH VENEER OVER STRUCTURAL BASE SECTION

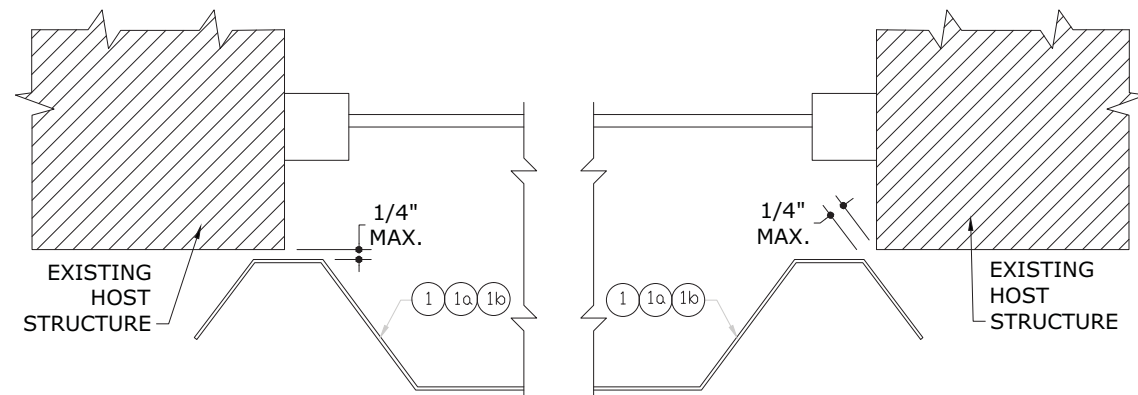

S WALL MOUNT CLOSURE DETAIL

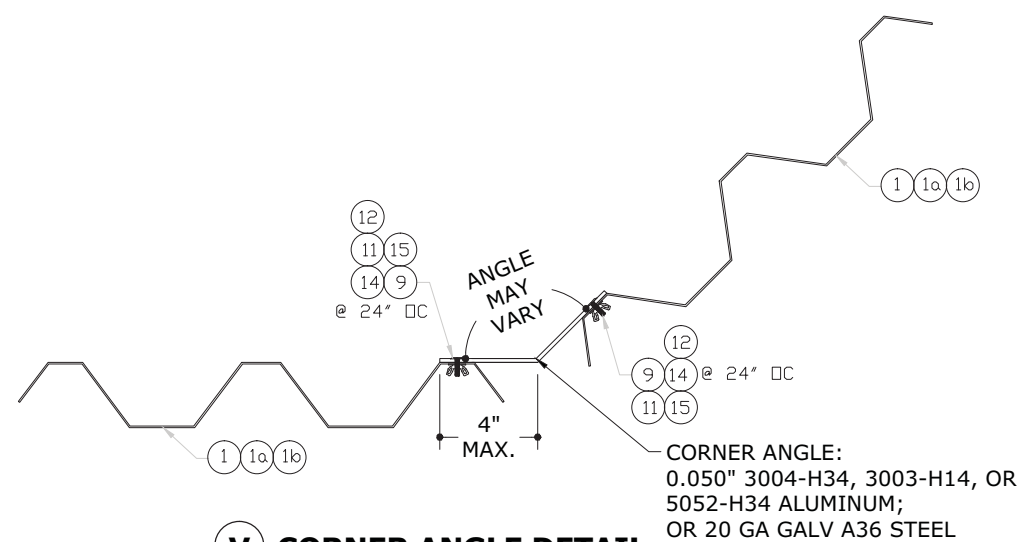

FRANK BENNARDO, PE
PE# 0046549 CA#9885

ENGINEERING EXPRESS
CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM

Town Country INDUSTRIES
Wholesale Aluminum and Building Products
A Division of AEC Supply Co., Inc.
400 WEST MCNAB ROAD
FT. LAUDERDALE, FL 33309
FL12856.3

DRWN	CHKD	DATE
CSL	FLB	4/01/15
RWN	FLB	8/01/17
CCB	RWN	6/17/20

REMARKS
INIT ISSUE
2017 FBC
2020 FBC

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF FRANK L. BENNARDO, P.E. ANY ALTERATIONS, ADDITIONS, HIGHLIGHTS, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

COPYRIGHT FRANK L. BENNARDO P.E.


20-26152

SCALE:
PAGE DESCRIPTION:

OF 10

C:\Users\rickn\Engineering Express\Production - Documents\Projects\20-26152 - FL12856.3 - 24ga Steel Storm Panel\WP\2020 FBC\20-26152c - FL12856.3 - DWG.dwg

09/30/2020 - 2:32pm rickn

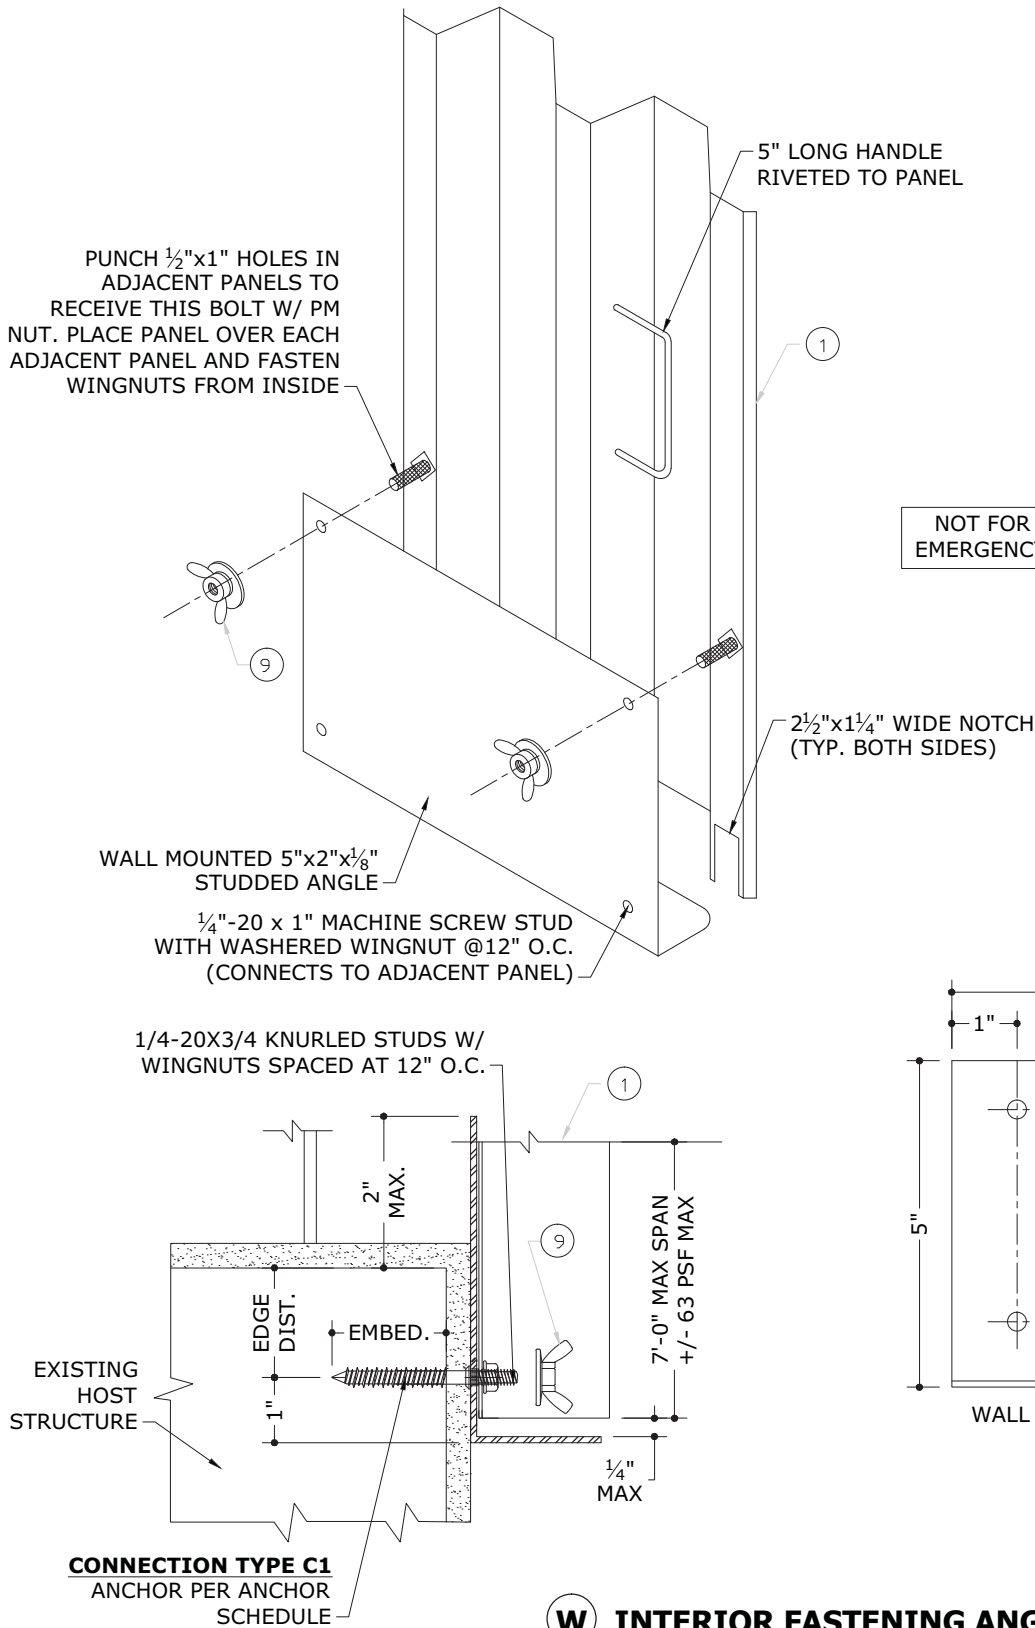

W INTERIOR FASTENING ANGLE ASSEMBLY
THESE DETAILS DEPICT THE CONNECTION OF ANY PANEL FOR AN OPENING WITH PANELS INSTALLED FROM INSIDE. USE OF THESE DETAILS SHALL BE IN CONJUNCTION WITH AN "H" HEADER OR "U" HEADER TOP MOUNT.

FRANK BENNARDO, PE
PE# 0046549 CA#9885



CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM

Town & Country
INDUSTRIES
Wholesale Aluminum and Building Products
A Division of AEC Supply Co., Inc.

400 WEST MCNAB ROAD
FT. LAUDERDALE, FL 33309
FL12856.3

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CSL	FLB	4/01/15
2017 FBC	RWN	FLB	8/01/17
2020 FBC	CCB	RWN	6/17/20
THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF FRANK L. BENNARDO, P.E. * ALTERATIONS, ADDITIONS, HIGHLIGHTS OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.			

COPYRIGHT FRANK L. BENNARDO P.E.

20-26152

SCALE: -
PAGE DESCRIPTION:

62

OF
10

C:\Users\rickn\Engineering Express\Production - Documents\Projects\20-26152 - FL12856.3 - 24ga Steel Storm Panel\WP\2020 FBC\20-26152c - FL12856.3 - DWG.dwg 09/30/2020 - 2:32pm rickn

FRANK BENNARDO, PE
PE# 0046549 CA#9885



CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM

Town & Country
INDUSTRIES
Wholesale Aluminum and Building Products
A Division of AEC Supply Co., Inc.

400 WEST MCNAB ROAD
FT. LAUDERDALE, FL 33309
FL12856.3

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CSL	FLB	4/01/15
2017 FBC	RWN	FLB	8/01/17
2020 FBC	CCB	RWN	6/17/20
THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT THE WRITTEN PERMISSION OF FRANK L. BENNARDO, P.E. ANY ALTERATIONS, ADDITIONS, HIGHLIGHTS OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.			


COPYRIGHT FRANK L. BENNARDO P.E.

20-26152

SCALE: -
PAGE DESCRIPTION:

7

OF
10

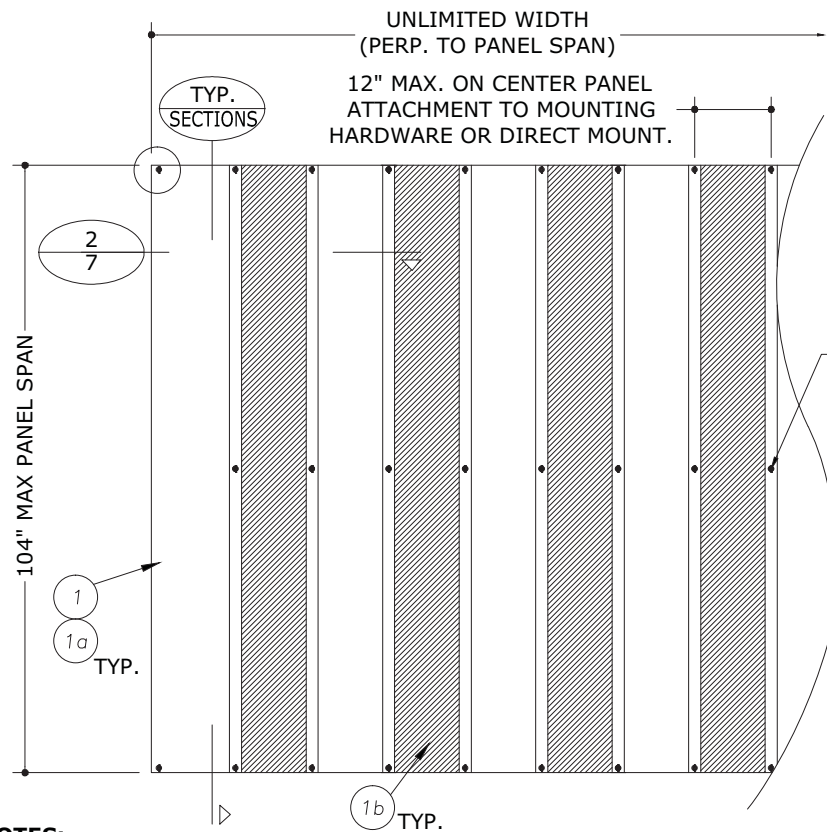

NOTES:

1. TOP MAY BE SLOPED OR RADIUS TO MATCH GEOMETRY OF OPENING. MOUNTING HARDWARE MUST BE ROLL-FORMED TO THE RADIUS; NO NOTCHING OF MOUNTING HARDWARE TO ACHIEVE SHAPES IS ALLOWED.
2. STORM PANELS MAY BE MOUNTED VERTICALLY OR HORIZONTALLY.
3. STEEL AND POLYCARBONATE PANELS SHALL ALTERNATE.
4. END PANELS SHALL BE STEEL PANELS ONLY.

POLYCARBONATE PANELS FASTENED TO ADJACENT STORM PANELS WITH 1/4"-20 SIDEWALK BOLT AND WASHERED WINGUT AT MIDSPAN, TYPICAL.

TABLE 2		
ALLOWABLE SPAN SCHEDULE (STEEL WITH POLYCARB PANELS)		
PANEL SPAN	ALLOWABLE DESIGN PRESSURE	
106"	+ 33.3 PSF	- 33.3 PSF
102"	+ 35.7 PSF	- 35.7 PSF
96"	+ 39.8 PSF	- 39.8 PSF
90"	+ 44.7 PSF	- 44.7 PSF
84"	+ 50.6 PSF	- 50.6 PSF
78"	+ 57.9 PSF	- 57.9 PSF
72"	+ 67.0 PSF	- 67.0 PSF

TABLE 2 NOTES:

- LINEAR INTERPOLATION BETWEEN SHUTTER SPANS IS NOT PERMITTED. FOR SPANS BETWEEN THOSE INDICATED ABOVE, THE DESIGN PRESSURES FOR THE NEXT HIGHER SPAN SHALL BE USED.
- DESIGN PRESSURES NOTED IN TABLE 2 APPLY TO ALL MOUNTING AND ANCHORAGE CONDITIONS AND SHALL NOT BE EXCEEDED.


TYPICAL ELEVATION WITH ALTERNATING STEEL AND POLYCARBONATE PANELS

1
7

N.T.S.

EXTERIOR ELEV

INTERIOR

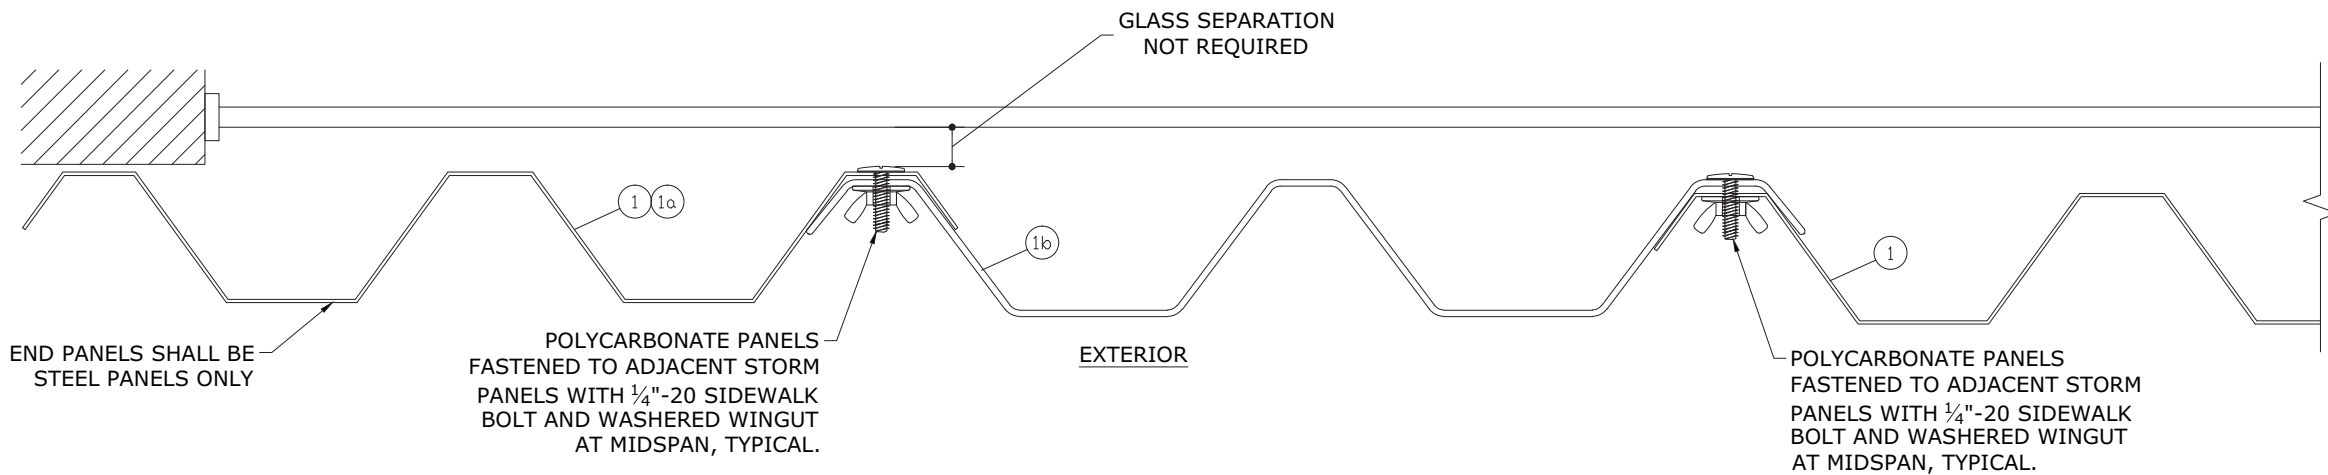

TYPICAL SECTION WITH ALTERNATING STEEL AND POLYCARBONATE PANELS



2
7



N.T.S.



HORIZ SECTION

ANCHOR SCHEDULES:

(SEE SHEET 10 FOR ANCHOR NOTES)




HOST STRUCT.	ANCHOR	LOAD (psf)	EDGE DISTANCES AS NOTED															
			Spans Up To 6'-0"					Spans Up To 8'-0"					Spans Up To 10'-0"					
			CONN TYPE					CONN TYPE					CONN TYPE					
			C1	C2	C3	C4	C5	C1	C2	C3	C4	C5	C1	C2	C3	C4	C5	
CONCRETE	1/4" ITW S.S. TAPCON WITH 1-3/4" EMBED AND 1" MIN. EDGE DISTANCE (3192 psi MIN CONCRETE) 	35	16.0"	16.0"	16.0"	10.5"	16.0"	16.0"	16.0"	16.0"	7.9"	16.0"	16.0"	16.0"	16.0"	16.0"	6.3"	16.0"
		46	16.0"	16.0"	16.0"	8.0"	16.0"	16.0"	16.0"	16.0"	6.0"	16.0"	16.0"	16.0"	16.0"	16.0"	4.7"	16.0"
		57	16.0"	16.0"	16.0"	6.5"	16.0"	16.0"	16.0"	16.0"	4.8"	16.0"	16.0"	13.9"	16.0"	16.0"	3.8"	11.5"
		67	16.0"	16.0"	16.0"	5.5"	16.0"	16.0"	15.3"	16.0"	4.0"	13.1"	16.0"	10.9"	16.0"	16.0"	3.2"	8.6"
		78	16.0"	16.0"	16.0"	4.7"	16.0"	16.0"	12.1"	16.0"	3.4"	9.7"	14.3"	8.8"	14.3"		6.7"	
		89	16.0"	15.4"	16.0"	4.1"	13.2"	15.7"	10.0"	15.7"	3.0"	7.7"	12.6"	7.4"	12.6"		5.5"	
		100	16.0"	12.8"	16.0"	3.6"	10.4"	14.0"	8.5"	14.0"		6.4"	11.2"	6.4"	10.8"		4.6"	
	1/4" DEWALT ULTRAACON WITH 1-3/4" EMBED AND 1" MIN. EDGE DISTANCE (2700 psi MIN CONCRETE) 	35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	13.0"	16.0"	16.0"	16.0"	16.0"	16.0"	10.4"	16.0"
		46	16.0"	16.0"	16.0"	13.1"	16.0"	16.0"	16.0"	16.0"	9.8"	16.0"	16.0"	16.0"	16.0"	16.0"	7.7"	16.0"
		57	16.0"	16.0"	16.0"	10.6"	16.0"	16.0"	16.0"	16.0"	7.8"	16.0"	16.0"	16.0"	13.7"	16.0"	6.1"	11.4"
		67	16.0"	16.0"	16.0"	8.9"	16.0"	16.0"	15.1"	16.0"	6.5"	12.9"	16.0"	10.8"	16.0"	16.0"	5.1"	8.5"
		78	16.0"	16.0"	16.0"	7.5"	16.0"	16.0"	11.9"	16.0"	5.5"	9.6"	14.2"	8.7"	14.2"	4.4"	6.6"	
		89	16.0"	15.2"	16.0"	6.5"	13.0"	15.5"	9.9"	15.5"	4.8"	7.6"	12.4"	7.3"	12.4"		5.4"	
		100	16.0"	12.7"	16.0"	5.8"	10.3"	13.8"	8.4"	13.8"	4.3"	6.3"	11.0"	6.3"	10.7"		4.6"	
	1/4" ITW SAMMYS SSC W/ 2-1/4" MIN EMBED AND 1-1/4" MIN. EDGE DISTANCE (3295 psi MIN CONCRETE) 	35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	15.8"	16.0"
		46	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	15.0"	16.0"	16.0"	16.0"	16.0"	16.0"	11.8"	16.0"
		57	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	11.9"	16.0"	16.0"	16.0"	16.0"	16.0"	9.3"	16.0"
		67	16.0"	16.0"	16.0"	13.6"	16.0"	16.0"	16.0"	16.0"	10.0"	16.0"	16.0"	16.0"	16.0"	16.0"	7.9"	13.7"
		78	16.0"	16.0"	16.0"	11.5"	16.0"	16.0"	16.0"	16.0"	8.5"	15.5"	16.0"	14.0"	16.0"	16.0"	6.7"	10.7"
		89	16.0"	16.0"	16.0"	10.0"	16.0"	16.0"	15.9"	16.0"	7.4"	12.3"	16.0"	11.8"	16.0"	16.0"	5.8"	8.7"
		100	16.0"	16.0"	16.0"	8.8"	16.0"	16.0"	13.6"	16.0"	6.5"	10.2"	16.0"	10.1"	16.0"	16.0"	5.2"	7.4"
	1/4-20 ALL POINTS SOLID-SET WITH 7/8" MIN EMBED AND 1-1/4" MIN. EDGE DISTANCE (3000 psi MIN CONCRETE) 	35	16.0"	16.0"	16.0"	13.6"	16.0"	16.0"	16.0"	16.0"	10.2"	16.0"	16.0"	16.0"	16.0"	16.0"	8.2"	16.0"
		46	16.0"	16.0"	16.0"	10.4"	16.0"	16.0"	16.0"	16.0"	7.7"	16.0"	16.0"	14.0"	16.0"	16.0"	6.0"	13.1"
		57	16.0"	16.0"	16.0"	8.4"	16.0"	16.0"	14.3"	16.0"	6.1"	13.4"	13.8"	9.8"	13.8"	16.0"	4.8"	8.1"
67		16.0"	16.0"	16.0"	7.0"	16.0"	14.7"	10.8"	14.7"	5.1"	9.2"	11.7"	7.7"	11.7"	16.0"	4.0"	6.0"	
78		16.0"	13.6"	16.0"	5.9"	12.5"	12.6"	8.5"	12.6"	4.3"	6.8"	10.1"	6.2"	10.1"	16.0"	3.4"	4.7"	
89		14.7"	10.9"	14.7"	5.1"	9.3"	11.1"	7.0"	11.1"	3.8"	5.4"	8.8"	5.2"	8.8"		3.9"		
100		13.1"	9.0"	13.1"	4.5"	7.4"	9.8"	6.0"	9.8"	3.3"	4.5"	7.9"	4.5"	7.6"		3.3"		
1/4" DEWALT TAPPER WITH 1-3/4" MIN EMBED AND 1-1/2" MIN. EDGE DISTANCE (3000 psi MIN CONCRETE) 	35	16.0"	16.0"	16.0"	11.3"	16.0"	16.0"	16.0"	16.0"	8.5"	16.0"	13.0"	13.0"	13.0"	16.0"	6.8"	13.0"	
	46	16.0"	16.0"	16.0"	8.6"	16.0"	12.4"	12.4"	12.4"	6.4"	12.4"	9.9"	8.1"	9.9"	16.0"	4.9"	7.6"	
	57	13.3"	13.3"	13.3"	6.9"	13.3"	10.0"	8.3"	10.0"	5.0"	7.7"	8.0"	5.7"	8.0"	16.0"	3.9"	4.7"	
	67	11.3"	10.5"	11.3"	5.8"	11.2"	8.5"	6.3"	8.5"	4.2"	5.3"	6.8"	4.4"	6.8"	16.0"	3.3"	3.5"	
	78	9.7"	7.9"	9.7"	4.9"	7.3"	7.3"	4.9"	7.3"	3.5"	4.0"	5.8"	3.6"	5.8"				
	89	8.5"	6.3"	8.5"	4.2"	5.4"	6.4"	4.1"	6.4"	3.0"	3.2"	5.1"	3.0"	5.1"				
	100	7.6"	5.2"	7.6"	3.7"	4.3"	5.7"	3.5"	5.7"			4.6"		4.4"				


HOST STRUCT.	ANCHOR	LOAD (psf)	EDGE DISTANCES AS NOTED														
			Spans Up To 6'-0"					Spans Up To 8'-0"					Spans Up To 10'-0"				
			CONN TYPE					CONN TYPE					CONN TYPE				
CONCRETE	1/4" MILLENIUM MILLFAST WITH 1-3/4" EMBED AND 2-1/2" EDGE DISTANCE (3275psi MIN CONCRETE) 	35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	
		46	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	14.5"	16.0"	16.0"	16.0"	11.2"	16.0"	
		57	16.0"	16.0"	16.0"	15.7"	16.0"	16.0"	16.0"	16.0"	11.3"	16.0"	16.0"	13.0"	16.0"	8.8"	10.8"
		67	16.0"	16.0"	16.0"	13.1"	16.0"	16.0"	14.3"	16.0"	9.4"	12.2"	15.6"	10.2"	15.6"	7.4"	8.0"
		78	16.0"	16.0"	16.0"	11.0"	16.0"	16.0"	11.3"	16.0"	8.0"	9.1"	13.4"	8.2"	13.4"	6.3"	6.2"
		89	16.0"	14.4"	16.0"	9.5"	12.3"	14.7"	9.3"	14.7"	6.9"	7.2"	11.7"	6.9"	11.7"	5.4"	5.1"
	1/4" MILLENIUM MILLFAST WITH 1-3/4" EMBED AND 1" EDGE DISTANCE (3275psi MIN CONCRETE) 	100	16.0"	12.0"	16.0"	8.3"	9.8"	13.1"	7.9"	13.1"	6.1"	6.0"	10.4"	5.9"	10.1"	4.8"	4.3"
		35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	13.5"	16.0"	16.0"	16.0"	16.0"	10.8"	16.0"
		46	16.0"	16.0"	16.0"	13.7"	16.0"	16.0"	16.0"	16.0"	10.3"	16.0"	16.0"	14.8"	16.0"	8.0"	13.8"
		57	16.0"	16.0"	16.0"	11.1"	16.0"	16.0"	15.0"	16.0"	8.0"	14.1"	14.6"	10.3"	14.6"	6.3"	8.6"
		67	16.0"	16.0"	16.0"	9.3"	16.0"	15.5"	11.4"	15.5"	6.7"	9.7"	12.4"	8.1"	12.4"	5.3"	6.4"
		78	16.0"	14.3"	16.0"	7.8"	13.2"	13.3"	9.0"	13.3"	5.7"	7.2"	10.6"	6.5"	10.6"	4.5"	5.0"
	#12 SMS W/ 2" EYEWALL ARMOR INSERT W/ 2" EMBED AND 2" EDGE DISTANCE (2000psi MIN CONC) 	89	15.6"	11.5"	15.6"	6.7"	9.8"	11.7"	7.4"	11.7"	4.9"	5.7"	9.3"	5.5"	9.3"		4.1"
		100	13.8"	9.5"	13.8"	5.9"	7.8"	10.4"	6.3"	10.4"	4.3"	4.8"	8.3"	4.7"	8.1"		
		35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	13.7"	16.0"	16.0"	16.0"	16.0"	11.0"	16.0"
		46	16.0"	16.0"	16.0"	13.9"	16.0"	16.0"	16.0"	16.0"	10.4"	16.0"	16.0"	16.0"	16.0"	8.1"	16.0"
		57	16.0"	16.0"	16.0"	11.2"	16.0"	16.0"	16.0"	16.0"	8.2"	16.0"	16.0"	13.3"	16.0"	6.4"	11.0"
		67	16.0"	16.0"	16.0"	9.4"	16.0"	16.0"	14.7"	16.0"	6.9"	12.5"	16.0"	10.4"	16.0"	5.4"	8.2"
	#12 SMS W/ 2.75" EYEWALL ARMOR INSERT W/ 2.5" EMBED AND 2" EDGE DISTANCE (2000psi MIN CONC) 	78	16.0"	16.0"	16.0"	8.0"	16.0"	16.0"	11.6"	16.0"	5.8"	9.3"	13.7"	8.4"	13.7"	4.6"	6.4"
		89	16.0"	14.8"	16.0"	6.9"	12.6"	15.0"	9.6"	15.0"	5.1"	7.4"	12.0"	7.1"	12.0"	4.0"	5.2"
		100	16.0"	12.3"	16.0"	6.1"	10.0"	13.4"	8.1"	13.4"	4.5"	6.2"	10.7"	6.1"	10.4"	3.6"	4.4"
		35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	15.6"	16.0"
		46	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	14.8"	16.0"	16.0"	16.0"	16.0"	11.5"	16.0"
		57	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	11.7"	16.0"	16.0"	16.0"	16.0"	9.1"	14.2"


HOST STRUCT.	ANCHOR	LOAD (psf)	EDGE DISTANCES AS NOTED															
			Spans Up To 6'-0"					Spans Up To 8'-0"					Spans Up To 10'-0"					
			CONN TYPE					CONN TYPE					CONN TYPE					
			C1	C2	C3	C4	C5	C1	C2	C3	C4	C5	C1	C2	C3	C4	C5	
CONCRETE	1/4" ITW S.S. TAPCON WITH 1-3/4" EMBED AND 2-1/2" MIN. EDGE DISTANCE (3192 psi MIN CONCRETE) 	35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	15.5"	16.0"
		46	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	14.7"	16.0"	16.0"	16.0"	16.0"	11.4"	16.0"
		57	16.0"	16.0"	16.0"	15.8"	16.0"	16.0"	16.0"	16.0"	16.0"	11.5"	16.0"	16.0"	16.0"	16.0"	9.0"	13.5"
		67	16.0"	16.0"	16.0"	13.3"	16.0"	16.0"	16.0"	16.0"	9.6"	15.3"	16.0"	12.8"	16.0"	16.0"	7.6"	10.1"
		78	16.0"	16.0"	16.0"	11.2"	16.0"	16.0"	16.0"	14.2"	16.0"	8.2"	11.4"	16.0"	10.3"	16.0"	6.4"	7.8"
		89	16.0"	16.0"	16.0"	9.7"	15.5"	16.0"	11.7"	16.0"	7.1"	9.1"	14.8"	8.7"	14.8"	5.6"	6.4"	
		100	16.0"	15.1"	16.0"	8.5"	12.3"	16.0"	10.0"	16.0"	6.3"	7.5"	13.1"	7.5"	12.7"	5.0"	5.4"	
	1/4" DEWALT ULTRACON WITH 1-3/4" EMBED AND 2-1/2" MIN. EDGE DISTANCE (2700 psi MIN CONCRETE) 	35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	15.8"	16.0"
		46	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	14.9"	16.0"	16.0"	16.0"	16.0"	11.6"	16.0"
		57	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	11.7"	16.0"	16.0"	14.2"	16.0"	9.1"	11.8"
		67	16.0"	16.0"	16.0"	13.5"	16.0"	16.0"	15.6"	16.0"	9.7"	13.3"	16.0"	11.1"	16.0"	7.6"	8.7"	
		78	16.0"	16.0"	16.0"	11.3"	16.0"	16.0"	12.3"	16.0"	8.2"	9.9"	14.6"	9.0"	14.6"	6.5"	6.8"	
		89	16.0"	15.7"	16.0"	9.8"	13.4"	16.0"	10.2"	16.0"	7.1"	7.9"	12.8"	7.5"	12.8"	5.6"	5.6"	
		100	16.0"	13.1"	16.0"	8.6"	10.6"	14.3"	8.7"	14.3"	6.3"	6.6"	11.4"	6.5"	11.1"	5.0"	4.7"	
	1/4" DEWALT PANELMATE (FEMALE, MALE, or PLUS) W/ 2" MIN EMBED AND 2-1/2" MIN. EDGE DISTANCE (3350 psi MIN CONC) 	35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	15.8"	16.0"
		46	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	15.0"	16.0"	16.0"	16.0"	16.0"	11.7"	16.0"
		57	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	11.8"	16.0"	16.0"	16.0"	16.0"	9.2"	13.5"
		67	16.0"	16.0"	16.0"	13.6"	16.0"	16.0"	16.0"	16.0"	9.8"	15.2"	16.0"	12.7"	16.0"	7.7"	10.0"	
		78	16.0"	16.0"	16.0"	11.4"	16.0"	16.0"	14.1"	16.0"	8.3"	11.3"	16.0"	10.3"	16.0"	6.6"	7.8"	
		89	16.0"	16.0"	16.0"	9.9"	15.4"	16.0"	11.7"	16.0"	7.2"	9.0"	14.7"	8.6"	14.7"	5.7"	6.4"	
		100	16.0"	15.0"	16.0"	8.7"	12.2"	16.0"	9.9"	16.0"	6.4"	7.5"	13.1"	7.4"	12.7"	5.1"	5.4"	
	1/4" ITW SAMMYS SSC W/ 2-1/4" MIN EMBED AND 2-1/2" MIN. EDGE DISTANCE (3295 psi MIN CONCRETE) 	35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"
		46	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	15.0"	16.0"
		57	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	15.1"	16.0"	16.0"	16.0"	16.0"	11.8"	16.0"
		67	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	12.7"	16.0"	16.0"	16.0"	16.0"	10.0"	14.3"
		78	16.0"	16.0"	16.0"	14.7"	16.0"	16.0"	16.0"	16.0"	10.7"	16.0"	16.0"	14.6"	16.0"	8.5"	11.1"	
		89	16.0"	16.0"	16.0"	12.7"	16.0"	16.0"	16.0"	16.0"	9.3"	12.9"	16.0"	12.3"	16.0"	7.4"	9.1"	
		100	16.0"	16.0"	16.0"	11.2"	16.0"	16.0"	14.1"	16.0"	8.2"	10.7"	16.0"	10.6"	16.0"	6.5"	7.7"	
1/4-20 ALL POINTS SOLID-SET WITH 7/8" MIN EMBED AND 2" MIN. EDGE DISTANCE (3000 psi MIN CONCRETE) 	35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	14.7"	16.0"	
	46	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	13.9"	16.0"	16.0"	16.0"	16.0"	10.8"	16.0"	
	57	16.0"	16.0"	16.0"	15.0"	16.0"	16.0"	16.0"	16.0"	10.9"	16.0"	16.0"	12.8"	16.0"	8.5"	10.6"		
	67	16.0"	16.0"	16.0"	12.6"	16.0"	16.0"	14.1"	16.0"	9.1"	12.0"	15.3"	10.0"	15.3"	7.1"	7.9"		
	78	16.0"	16.0"	16.0"	10.6"	16.0"	16.0"	11.1"	16.0"	7.7"	8.9"	13.2"	8.1"	13.2"	6.0"	6.1"		
	89	16.0"	14.2"	16.0"	9.1"	12.1"	14.4"	9.2"	14.4"	6.6"	7.1"	11.5"	6.8"	11.5"	5.2"	5.0"		
	100	16.0"	11.8"	16.0"	8.0"	9.6"	12.8"	7.8"	12.8"	5.9"	5.9"	10.3"	5.8"	10.0"	4.6"	4.3"		
1/4" DEWALT TAPPER WITH 1-3/4" MIN EMBED AND 3" MIN. EDGE DISTANCE (3000 psi MIN CONCRETE) 	35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	13.5"	16.0"	
	46	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	12.8"	16.0"	16.0"	16.0"	16.0"	9.9"	15.2"	
	57	16.0"	16.0"	16.0"	13.8"	16.0"	16.0"	16.0"	16.0"	10.0"	15.5"	16.0"	11.3"	16.0"	7.8"	9.4"		
	67	16.0"	16.0"	16.0"	11.5"	16.0"	16.0"	12.5"	16.0"	8.3"	10.7"	13.6"	8.9"	13.6"	6.5"	7.0"		
	78	16.0"	15.8"	16.0"	9.7"	14.5"	14.6"	9.9"	14.6"	7.0"	7.9"	11.7"	7.2"	11.7"	5.5"	5.5"		
	89	16.0"	12.6"	16.0"	8.4"	10.7"	12.8"	8.1"	12.8"	6.1"	6.3"	10.2"	6.0"	10.2"	4.8"	4.5"		
	100	15.2"	10.5"	15.2"	7.3"	8.5"	11.4"	6.9"	11.4"	5.4"	5.2"	9.1"	5.2"	8.8"	4.2"	3.8"		

C:\Users\rickn\Engineering Express\Production - Documents\Projects\20-26152 - FL12856.3 - 24ga Steel Storm Panel\WP12020 FBC\20-26152c - FL12856.3 - DWG.dwg
09/30/2020 - 2:32pm
rickn

ANCHOR SCHEDULES (CONTINUED):

HOST STRUCT.	ANCHOR	LOAD (psf)	EDGE DISTANCES AS NOTED														
			Spans Up To 6'-0"					Spans Up To 8'-0"					Spans Up To 10'-0"				
			CONN TYPE					CONN TYPE					CONN TYPE				
			C1	C2	C3	C4	C5	C1	C2	C3	C4	C5	C1	C2	C3	C4	C5
HOLLOW CONCRETE BLOCK	1/4" ITW S.S. TAPCON WITH 1-1/4" MIN. EMBED AND 2-1/2" MIN. EDGE DISTANCE 	35	14.6"	14.6"	14.6"	9.1"	14.6"	11.0"	11.0"	11.0"	6.8"	11.0"	8.8"	8.8"	8.8"	5.5"	8.8"
		46	11.1"	11.1"	11.1"	6.9"	11.1"	8.3"	8.3"	8.3"	5.2"	8.3"	6.7"	5.5"	6.7"	4.0"	5.1"
		57	9.0"	9.0"	9.0"	5.6"	9.0"	6.7"	5.6"	6.7"	4.0"	5.2"	5.4"	3.8"	5.4"	3.1"	3.2"
		67	7.6"	7.1"	7.6"	4.6"	7.5"	5.7"	4.2"	5.7"	3.3"	3.6"	4.6"		4.6"		
		78	6.6"	5.3"	6.6"	3.9"	4.9"	4.9"	3.3"	4.9"			3.9"		3.9"		
		89	5.8"	4.2"	5.8"	3.3"	3.6"	4.3"		4.3"			3.5"		3.5"		
		100	5.1"	3.5"	5.1"			3.8"		3.8"			3.1"				
	1/4" DEWALT ULTRAACON WITH 1-1/4" MIN. EMBED AND 2-1/2" MIN. EDGE DISTANCE 	35	16.0"	16.0"	16.0"	8.3"	16.0"	12.0"	12.0"	12.0"	6.2"	12.0"	9.6"	9.6"	9.6"	5.0"	9.6"
		46	12.2"	12.2"	12.2"	6.3"	12.2"	9.1"	9.1"	9.1"	4.7"	9.1"	7.3"	6.0"	7.3"		5.6"
		57	9.8"	9.8"	9.8"	5.1"	9.8"	7.4"	6.1"	7.4"		5.7"	5.9"	4.2"	5.9"		
		67	8.4"	7.8"	8.4"	4.2"	8.2"	6.3"	4.6"	6.3"			5.0"		5.0"		
		78	7.2"	5.8"	7.2"		5.3"			5.4"			4.3"		4.3"		
		89	6.3"	4.6"	6.3"			4.7"		4.7"							
		100	5.6"		5.6"			4.2"		4.2"							
	1/4" DEWALT PANELMATE (FEMALE, MALE, OR PLUS) W/ 1-1/4" MIN EMBED AND 3" MIN. EDGE DISTANCE 	35	16.0"	16.0"	16.0"	11.7"	16.0"	16.0"	16.0"	8.8"	16.0"	14.4"	14.4"	14.4"	7.0"	14.4"	
		46	16.0"	16.0"	16.0"	8.9"	16.0"	13.7"	13.7"	13.7"	6.6"	13.7"	11.0"	9.0"	11.0"	5.1"	8.4"
		57	14.7"	14.7"	14.7"	7.2"	14.7"	11.1"	9.1"	11.1"	5.2"	8.6"	8.8"	6.3"	8.8"	4.0"	5.2"
		67	12.5"	11.6"	12.5"	6.0"	12.4"	9.4"	6.9"	9.4"	4.3"	5.9"	7.5"	4.9"	7.5"		
		78	10.8"	8.7"	10.8"	5.0"	8.0"	8.1"	5.5"	8.1"		4.4"	6.5"		6.5"		
		89	9.4"	7.0"	9.4"	4.3"	5.9"	7.1"	4.5"	7.1"			5.7"		5.7"		
		100	8.4"	5.8"	8.4"		4.7"	6.3"		6.3"			5.0"		4.9"		
	1/4" ITW TAPCON SG W/ 1-1/4" MIN EMBED AND 2-1/2" MIN. EDGE DISTANCE 	35	16.0"	16.0"	16.0"	15.9"	16.0"	16.0"	16.0"	11.9"	16.0"	16.0"	16.0"	16.0"	9.6"	16.0"	
		46	16.0"	16.0"	16.0"	12.1"	16.0"	16.0"	16.0"	9.1"	16.0"	16.0"	16.0"	16.0"	7.1"	15.5"	
		57	16.0"	16.0"	16.0"	9.8"	16.0"	16.0"	16.0"	7.1"	15.8"	16.0"	11.6"	16.0"	5.6"	9.6"	
		67	16.0"	16.0"	16.0"	8.2"	16.0"	16.0"	12.8"	16.0"	6.0"	10.9"	13.9"	9.1"	13.9"	4.7"	7.1"
		78	16.0"	16.0"	16.0"	6.9"	14.8"	14.9"	10.1"	14.9"	5.1"	8.1"	11.9"	7.3"	11.9"	4.0"	5.6"
		89	16.0"	12.8"	16.0"	6.0"	11.0"	13.1"	8.3"	13.1"	4.4"	6.4"	10.5"	6.2"	10.5"	3.5"	4.6"
		100	15.5"	10.7"	15.5"	5.3"	8.7"	11.6"	7.1"	11.6"	3.9"	5.4"	9.3"	5.3"	9.0"	3.1"	3.9"
	1/4-20 ALL POINTS SOLID-SET WITH 7/8" MIN EMBED AND 2" MIN. EDGE DISTANCE 	35	16.0"	16.0"	16.0"	13.4"	16.0"	16.0"	16.0"	10.1"	16.0"	16.0"	16.0"	16.0"	8.1"	16.0"	
		46	16.0"	16.0"	16.0"	10.2"	16.0"	16.0"	16.0"	7.6"	16.0"	14.9"	12.2"	14.9"	5.9"	11.4"	
		57	16.0"	16.0"	16.0"	8.2"	16.0"	15.1"	12.4"	15.1"	6.0"	11.7"	12.1"	8.5"	12.1"	4.7"	7.1"
		67	16.0"	15.9"	16.0"	6.9"	16.0"	12.8"	9.4"	12.8"	5.0"	8.0"	10.3"	6.7"	10.3"	3.9"	5.3"
		78	14.7"	11.9"	14.7"	5.8"	10.9"	11.0"	7.4"	11.0"	4.3"	6.0"	8.8"	5.4"	8.8"	3.4"	4.1"
		89	12.9"	9.5"	12.9"	5.0"	8.1"	9.7"	6.1"	9.7"	3.7"	4.8"	7.7"	4.5"	7.7"		3.4"
		100	11.5"	7.9"	11.5"	4.4"	6.4"	8.6"	5.2"	8.6"	3.3"	4.0"	6.9"	3.9"	6.7"		
	1/4" MILLENNIUM MILLFAST ANCHOR W/ 1-1/4" EMBED AND 1" EDGE DISTANCE 	35	15.4"	15.4"	15.4"	6.6"	15.4"	11.5"	11.5"	11.5"	5.0"	11.5"	9.2"	9.2"	9.2"		9.2"
		46	11.7"	11.7"	11.7"	5.1"	11.7"	8.8"	8.8"	8.8"		8.8"	7.0"	5.7"	7.0"		5.4"
		57	9.4"	9.4"	9.4"	4.1"	9.4"	7.1"	5.8"	7.1"		5.5"	5.7"	4.0"	5.7"		
		67	8.0"	7.5"	8.0"		7.9"	6.0"	4.4"	6.0"			4.8"		4.8"		
		78	6.9"	5.6"	6.9"		5.1"	5.2"		5.2"			4.1"		4.1"		
		89	6.0"	4.4"	6.0"			4.5"		4.5"							
		100	5.4"		5.4"			4.0"		4.0"							
	1/4" MILLENNIUM MILLFAST ANCHOR W/ 1-1/4" EMBED AND 2-1/2" EDGE DISTANCE 	35	16.0"	16.0"	16.0"	10.0"	16.0"	12.7"	12.7"	12.7"	7.5"	12.7"	10.1"	10.1"	10.1"	6.0"	10.1"
		46	12.9"	12.9"	12.9"	7.6"	12.9"	9.7"	9.7"	9.7"	5.7"	9.7"	7.7"	6.3"	7.7"	4.4"	5.9"
		57	10.4"	10.4"	10.4"	6.2"	10.4"	7.8"	6.4"	7.8"	4.4"	6.0"	6.2"	4.4"	6.2"		
		67	8.8"	8.2"	8.8"	5.1"	8.7"	6.6"	4.9"	6.6"		4.1"	5.3"		5.3"		
		78	7.6"	6.1"	7.6"	4.3"	5.6"	5.7"		5.7"			4.6"		4.6"		
		89	6.7"	4.9"	6.7"		4.2"	5.0"		5.0"							
		100	5.9"	4.1"	5.9"			4.4"		4.4"							
	#12 SMS W/ 2" EYE WALL ARMOR INSERT W/ 1-1/4" EMBED WITH 2" EDGE DISTANCE 	35	16.0"	16.0"	16.0"	12.2"	16.0"	16.0"	16.0"	9.2"	16.0"	15.8"	15.8"	15.8"	7.3"	15.8"	
		46	16.0"	16.0"	16.0"	9.3"	16.0"	15.0"	15.0"	15.0"	6.9"	15.0"	12.0"	9.8"	12.0"	5.4"	9.2"
		57	16.0"	16.0"	16.0"	7.5"	16.0"	12.1"	10.0"	12.1"	5.4"	9.4"	9.7"	6.9"	9.7"	4.2"	5.7"
		67	13.7"	12.8"	13.7"	6.3"	13.5"	10.3"	7.6"	10.3"	4.5"	6.5"	8.2"	5.4"	8.2"	3.6"	4.2"
		78	11.8"	9.5"	11.8"	5.3"	8.8"	8.9"	6.0"	8.9"	3.8"	4.8"	7.1"	4.3"	7.1"	3.0"	3.3"
		89	10.3"	7.6"	10.3"	4.6"	6.5"	7.8"	4.9"	7.8"	3.3"	3.8"	6.2"	3.6"	6.2"		
		100	9.2"	6.3"	9.2"	4.0"	5.2"	6.9"	4.2"	6.9"		3.2"	5.5"	3.1"	5.4"		
	1/4" EA MALE BOLT, 1-1/4" EMBED AND 1.25" EDGE DISTANCE 	35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	13.4"	16.0"	16.0"	16.0"	10.7"	16.0"		
		46	16.0"	16.0"	16.0"	13.6"	16.0"	16.0"	16.0"	10.2"	16.0"	16.0"	15.6"	16.0"	7.9"	14.5"	
		57	16.0"	16.0"	16.0"	11.0"	16.0"	16.0"	15.8"	16.0"	8.0"	14.8"	15.3"	10.8"	15.3"	6.2"	9.0"
		67	16.0"	16.0"	16.0"	9.2"	16.0"	16.0"	12.0"	16.0"	6.7"	10.2"	13.0"	8.5"	13.0"	5.2"	6.7"
		78	16.0"	15.1"	16.0"	7.7"	13.9"	14.0"	9.4"	14.0"	5.6"	7.6"	11.2"	6.9"	11.2"	4.4"	5.2"
		89	16.0"	12.0"	16.0"	6.7"	10.3"	12.3"	7.8"	12.3"	4.9"	6.0"	9.8"	5.8"	9.8"		4.3"
		100	14.6"	10.0"	14.6"	5.9"	8.2"	10.9"	6.6"	10.9"	4.3"	5.0"	8.7"	5.0"	8.5"		

HOST STRUCT.	ANCHOR	LOAD (psf)	EDGE DISTANCES AS NOTED														
			Spans Up To 6'-0" CONN TYPE					Spans Up To 8'-0" CONN TYPE					Spans Up To 10'-0" CONN TYPE				
			C1	C2	C3	C4	C5	C1	C2	C3	C4	C5	C1	C2	C3	C4	C5
HOLLOW CONCRETE BLOCK	1/4" ITW S.S. TAPCON WITH 1-1/4" MIN. EMBED AND 1" MIN. EDGE DISTANCE 	35	10.7"	10.7"	10.7"	4.8"	10.7"	8.0"	8.0"	8.0"	3.6"	8.0"	6.4"	6.4"	6.4"		6.4"
		46	8.1"	8.1"	8.1"	3.6"	8.1"	6.1"	6.1"	6.1"		6.1"	4.9"	4.0"	4.9"		3.7"
		57	6.6"	6.6"	6.6"		6.6"	4.9"	4.1"	4.9"		3.8"	3.9"		3.9"		
		67	5.6"	5.2"	5.6"		5.5"	4.2"	3.1"	4.2"			3.4"		3.4"		
		78	4.8"	3.9"	4.8"		3.6"	3.6"		3.6"							
		89	4.2"	3.1"	4.2"			3.2"		3.2"							
		100	3.7"		3.7"												
	1/4" DEWALT ULTRA CON WITH 1-1/4" MIN. EMBED AND 1" MIN. EDGE DISTANCE 	35	16.0"	16.0"	16.0"	8.9"	16.0"	12.0"	12.0"	12.0"	6.7"	12.0"	9.6"	9.6"	9.6"	5.4"	9.6"
		46	12.2"	12.2"	12.2"	6.8"	12.2"	9.1"	9.1"	9.1"	5.1"	9.1"	7.3"	6.0"	7.3"		5.6"
		57	9.8"	9.8"	9.8"	5.5"	9.8"	7.4"	6.1"	7.4"		5.7"	5.9"	4.2"	5.9"		
		67	8.4"	7.8"	8.4"	4.6"	8.2"	6.3"	4.6"	6.3"			5.0"		5.0"		
		78	7.2"	5.8"	7.2"		5.3"	5.4"		5.4"			4.3"		4.3"		
		89	6.3"	4.6"	6.3"			4.7"		4.7"							
		100	5.6"		5.6"			4.2"		4.2"							
	1/4" DEWALT PANELMATE (MALE OR PLUS) W/ 1-1/4" MIN EMBED AND 2" MIN. EDGE DISTANCE 	35	16.0"	16.0"	16.0"	12.3"	16.0"	16.0"	16.0"	16.0"	9.2"	16.0"	15.0"	15.0"	15.0"	7.4"	15.0"
		46	16.0"	16.0"	16.0"	9.4"	16.0"	14.2"	14.2"	14.2"	7.0"	14.2"	11.4"	9.3"	11.4"	5.4"	8.7"
		57	15.3"	15.3"	15.3"	7.5"	15.3"	11.5"	9.5"	11.5"	5.5"	8.9"	9.2"	6.5"	9.2"	4.3"	5.4"
		67	13.0"	12.1"	13.0"	6.3"	12.8"	9.8"	7.2"	9.8"	4.6"	6.1"	7.8"	5.1"	7.8"		4.0"
		78	11.2"	9.0"	11.2"	5.3"	8.3"	8.4"	5.7"	8.4"		4.6"	6.7"	4.1"	6.7"		
		89	9.8"	7.2"	9.8"	4.6"	6.2"	7.4"	4.7"	7.4"			5.9"		5.9"		
		100	8.7"	6.0"	8.7"	4.0"	4.9"	6.5"		6.5"			5.2"		5.1"		
	1/4" ITW TAPCON SG W/ 1-1/4" MIN EMBED AND 1-1/4" MIN. EDGE DISTANCE 	35	16.0"	16.0"	16.0"	9.6"	16.0"	16.0"	16.0"	16.0"	7.2"	16.0"	16.0"	16.0"	16.0"	5.8"	16.0"
		46	16.0"	16.0"	16.0"	7.3"	16.0"	16.0"	16.0"	16.0"	5.5"	16.0"	16.0"	16.0"	16.0"	4.3"	15.5"
		57	16.0"	16.0"	16.0"	5.9"	16.0"	16.0"	16.0"	16.0"	4.4"	15.8"	16.0"	11.6"	16.0"	3.4"	9.6"
67		16.0"	16.0"	16.0"	5.0"	16.0"	16.0"	12.8"	16.0"	3.7"	10.9"	13.9"	9.1"	13.9"		7.1"	
78		16.0"	16.0"	16.0"	4.2"	14.8"	14.9"	10.1"	14.9"	3.1"	8.1"	11.9"	7.3"	11.9"		5.6"	
89		16.0"	12.8"	16.0"	3.7"	11.0"	13.1"	8.3"	13.1"		6.4"	10.5"	6.2"	10.5"		4.6"	
100		15.5"	10.7"	15.5"	3.3"	8.7"	11.6"	7.1"	11.6"		5.4"	9.3"	5.3"	9.0"		3.9"	
1/4-20 ALL POINTS SOLID- SET WITH 7/8" MIN EMBED AND 1-1/4" MIN. EDGE DISTANCE 	35	16.0"	16.0"	16.0"	8.1"	16.0"	14.3"	14.3"	14.3"	6.0"	14.3"	11.4"	11.4"	11.4"	4.8"	11.4"	
	46	14.5"	14.5"	14.5"	6.1"	14.5"	10.9"	10.9"	10.9"	4.6"	10.9"	8.7"	7.1"	8.7"	3.6"	6.6"	
	57	11.7"	11.7"	11.7"	4.9"	11.7"	8.8"	7.2"	8.8"	3.6"	6.8"	7.0"	5.0"	7.0"		4.1"	
	67	9.9"	9.2"	9.9"	4.1"	9.8"	7.5"	5.5"	7.5"	3.0"	4.7"	6.0"	3.9"	6.0"		3.1"	
	78	8.5"	6.9"	8.5"	3.5"	6.4"	6.4"	4.3"	6.4"		3.5"	5.1"	3.1"	5.1"			
	89	7.5"	5.5"	7.5"	3.0"	4.7"	5.6"	3.6"	5.6"			4.5"		4.5"			
	100	6.7"	4.6"	6.7"		3.7"	5.0"	3.0"	5.0"			4.0"		3.9"			

HOST STRUCT.	ANCHOR	LOAD (psf)	EDGE DISTANCES AS NOTED														
			Spans Up To 6'-0" CONN TYPE					Spans Up To 8'-0" CONN TYPE					Spans Up To 10'-0" CONN TYPE				
			C1	C2	C3	C4	C5	C1	C2	C3	C4	C5	C1	C2	C3	C4	C5
GROUT-FILLED CONCRETE BLOCK	#12 SMS W/ 2" EYEWALL ARMOR INSERT W/ 2" EMBED AND 2" EDGE DISTANCE 	35	16.0"	16.0"	16.0"	14.9"	16.0"	16.0"	16.0"	16.0"	11.2"	16.0"	16.0"	16.0"	16.0"	9.0"	16.0"
		46	16.0"	16.0"	16.0"	11.4"	16.0"	16.0"	16.0"	16.0"	8.5"	16.0"	16.0"	16.0"	16.0"	6.6"	15.1"
		57	16.0"	16.0"	16.0"	9.2"	16.0"	16.0"	16.0"	16.0"	6.7"	15.4"	15.9"	11.3"	15.9"	5.3"	9.4"
		67	16.0"	16.0"	16.0"	7.7"	16.0"	16.0"	12.5"	16.0"	5.6"	10.6"	13.6"	8.9"	13.6"	4.4"	7.0"
		78	16.0"	15.7"	16.0"	6.5"	14.5"	14.6"	9.8"	14.6"	4.8"	7.9"	11.6"	7.2"	11.6"	3.8"	5.4"
		89	16.0"	12.5"	16.0"	5.6"	10.7"	12.8"	8.1"	12.8"	4.2"	6.3"	10.2"	6.0"	10.2"	3.3"	4.5"
		100	15.1"	10.4"	15.1"	5.0"	8.5"	11.4"	6.9"	11.4"	3.7"	5.2"	9.1"	5.2"	8.8"		3.8"
	5/16" ITW TAPCON XL W/ 2-1/4" MIN. EMBED AND 4" EDGE DISTANCE 	35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"
		46	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"
		57	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	13.6"	16.0"
		67	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	14.6"	16.0"	16.0"	16.0"	16.0"	11.4"	13.9"
		78	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	12.3"	15.7"	16.0"	14.2"	16.0"	9.7"	10.8"
		89	16.0"	16.0"	16.0"	14.6"	16.0"	16.0"	16.0"	16.0"	10.7"	12.5"	16.0"	11.9"	16.0"	8.4"	8.9"
		100	16.0"	16.0"	16.0"	12.9"	16.0"	16.0"	13.8"	16.0"	9.4"	10.4"	16.0"	10.3"	16.0"	7.5"	7.5"
	5/16" DEWALT ULTRA CON W/ 2-1/4" MIN. EMBED 	35	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	16.0"	14.0"	16.0"	16.0"	16.0"	16.0"	11.2"	16.0"
		46	16.0"	16.0"	16.0"	14.2"	16.0"	16.0"	16.0"	16.0"	10.6"	16.0"	15.1"	12.4"	15.1"	8.2"	11.6"
		57	16.0"	16.0"	16.0"	11.5"	16.0"	15.3"	12.6"	15.3"	8.3"	11.8"	12.2"	8.6"	12.2"	6.4"	7.2"
		67	16.0"	16.0"	16.0"	9.6"	16.0"	13.0"	9.5"	13.0"	6.9"	8.1"	10.4"	6.8"	10.4"	5.4"	5.3"
		78	14.9"	12.0"	14.9"	8.0"	11.1"	11.2"	7.5"	11.2"	5.8"	6.0"	8.9"	5.5"	8.9"		
		89	13.0"	9.6"	13.0"	6.9"	8.2"	9.8"	6.2"	9.8"	5.0"		7.8"		7.8"		
		100	11.6"	8.0"	11.6"	6.1"	6.5"	8.7"	5.3"	8.7"			7.0"		6.7"		

1. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
2. WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
3. ALL CONCRETE ANCHORS SHALL BE INSTALLED TO NON-CRACKED CONCRETE ONLY.
4. MINIMUM EMBEDMENT AND EDGE DISTANCE SHALL BE AS NOTED IN ANCHOR SCHEDULE. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
5. ANCHOR SCHEDULE APPLIES TO ALL PRODUCTS CERTIFIED HEREIN, BUT ONLY PROVIDES MAXIMUM ALLOWABLE ANCHOR SPACING. MAXIMUM ALLOWABLE SPANS AND PRESSURES INDICATED IN SPAN SCHEDULE(S) SHALL APPLY.
6. WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
11. MACHINE SCREWS SHALL HAVE MINIMUM OF 1/2" ENGAGEMENT OF THREADS IN BASE ANCHOR AND MAY HAVE EITHER A PAN HEAD, TRUSS HEAD, OR WAFER HEAD ("SIDEWALK BOLT") U.N.O.
12.  DESIGNATES ANCHOR CONDITIONS WHICH ARE NOT ACCEPTABLE FOR USE.
13. * DESIGNATES ANCHORS WHICH ARE REMOVABLE AND MAY BE USED FOR DIRECT MOUNT INSTALLATIONS.
14. WHEN ANCHORING TO HOLLOW BLOCK, SDS DRILLS SHOULD NOT BE USED TO DRILL INTO HOLLOW BLOCK, NOR SHOULD IMPACT DRILLS BE USED TO INSTALL CONCRETE SCREWS TO HOLLOW BLOCK